



D/2 + 6
(MIN.)
D/2 + 12
(MAX.)

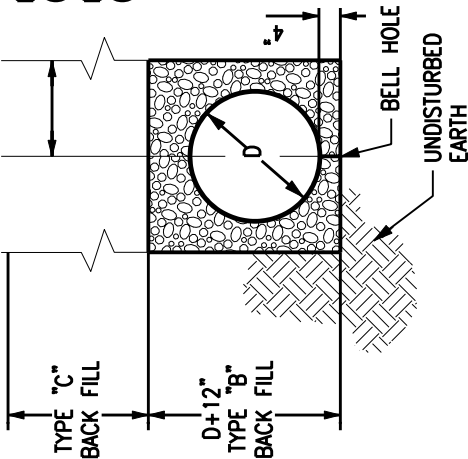

NOTES:

1. ACCEPTABLE MATERIALS TO BE USED: 4" OR 6" PIPE, WHICH CAN BE SCHEDULE 40 PLASTIC OR SDR 35 w/ SDR 26 FITTINGS, AND O-RING JOINTS CONFORMING TO ASTM D-3034 WITH NO FITTINGS OVER 45 DEGREES. FOR STEEPER SLOPES, USE STEP DOWN PROCEDURE.
2. TYPE "B" BACK FILL SHALL BE GRAVEL OR LIMESTONE #67 OR #57 CONFORMING TO ODOT SPECIFICATIONS.
3. TYPE "C" BACK FILL SHALL BE NATURAL SOIL FREE FROM TOE FOLLOWING; STONES LARGER THAN 6" ACROSS THEIR GREATEST DIMENSION, VEGETATION, DEBRIS, RUBBISH, OR FROZEN MATERIAL, COMPACTED TO 90% OF ITS LABORATORY DRY WEIGHT.

TYP. TRENCH

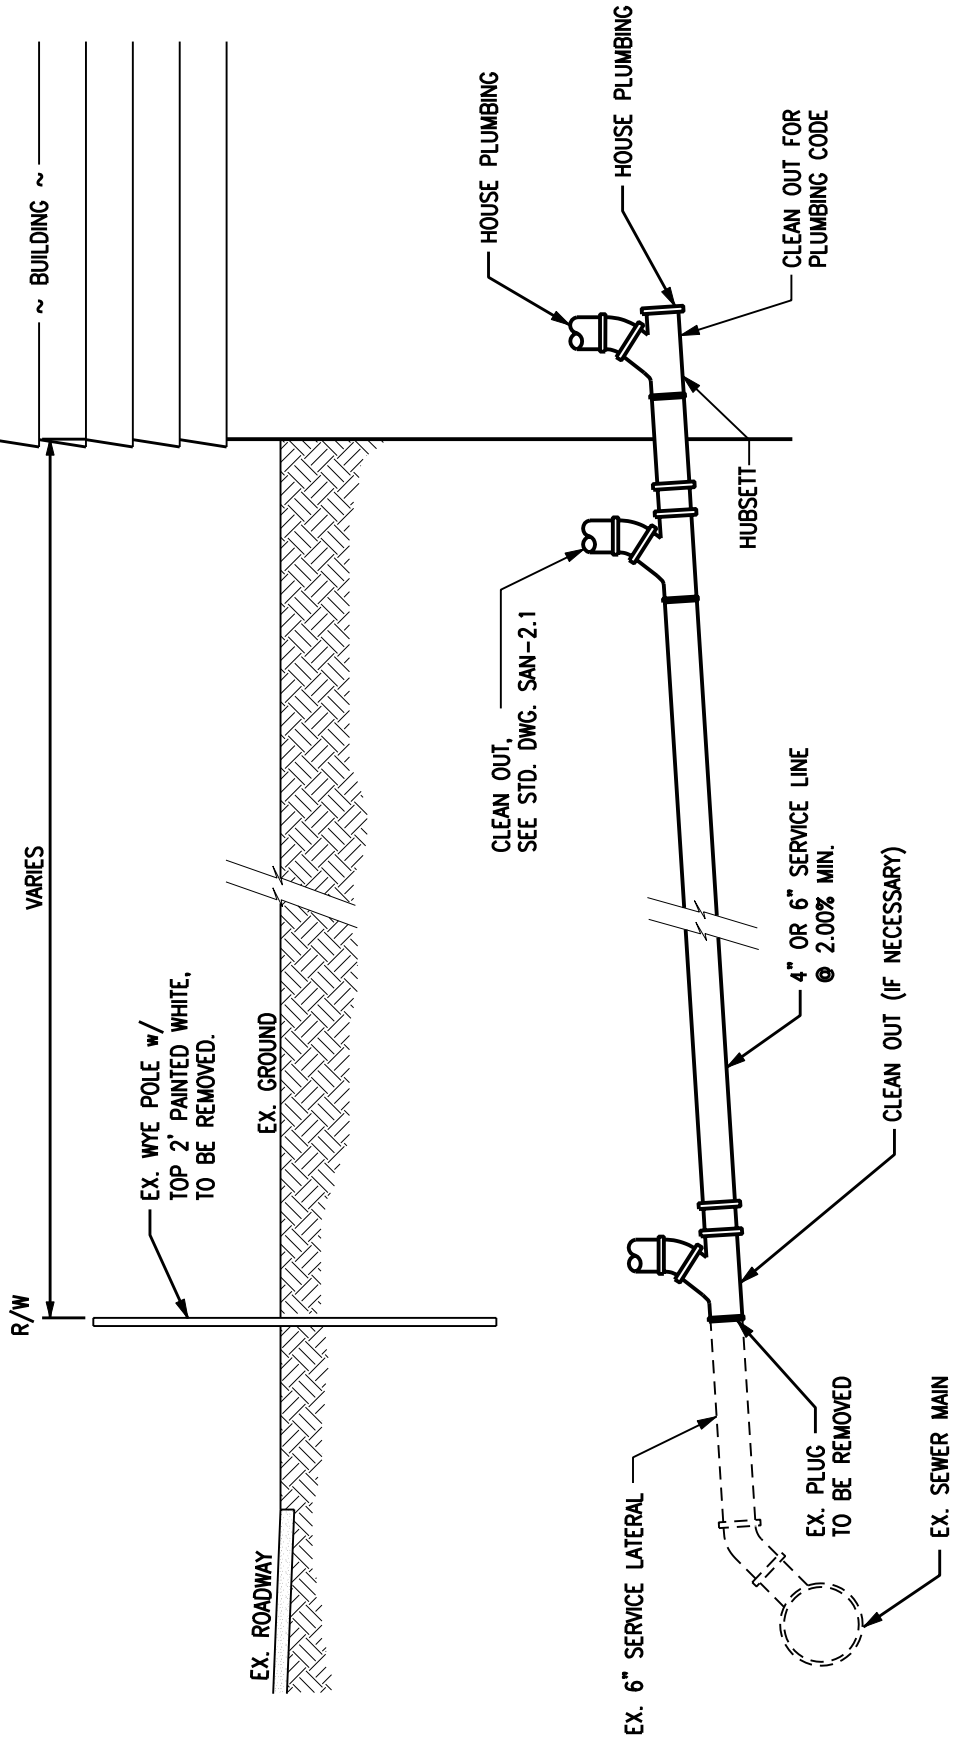

DATE: 10/20/06

APPROVED: _____
VILLAGE ENGINEER: ADAM D. VOIS, P.E.

ADR
& ASSOCIATES, LTD.

88 WEST CHURCH ST
NEWARK, OHIO 43055
(740) 345-1921 (ph)
(740) 345-4994 (fax)

~ THE VILLAGE OF HANOVER, OHIO ~

**4" OR 6" SANITARY SEWER SERVICE
(R/W TO BUILDING)**

SEWER TAP INSTALLATION
STANDARD CONSTRUCTION
DRAWINGS

DRAWING NO.
SAN-1.2
SHEET 1 OF 1