


CRCWD (CASTLE ROCK COUNTY WATER DISTRICT)

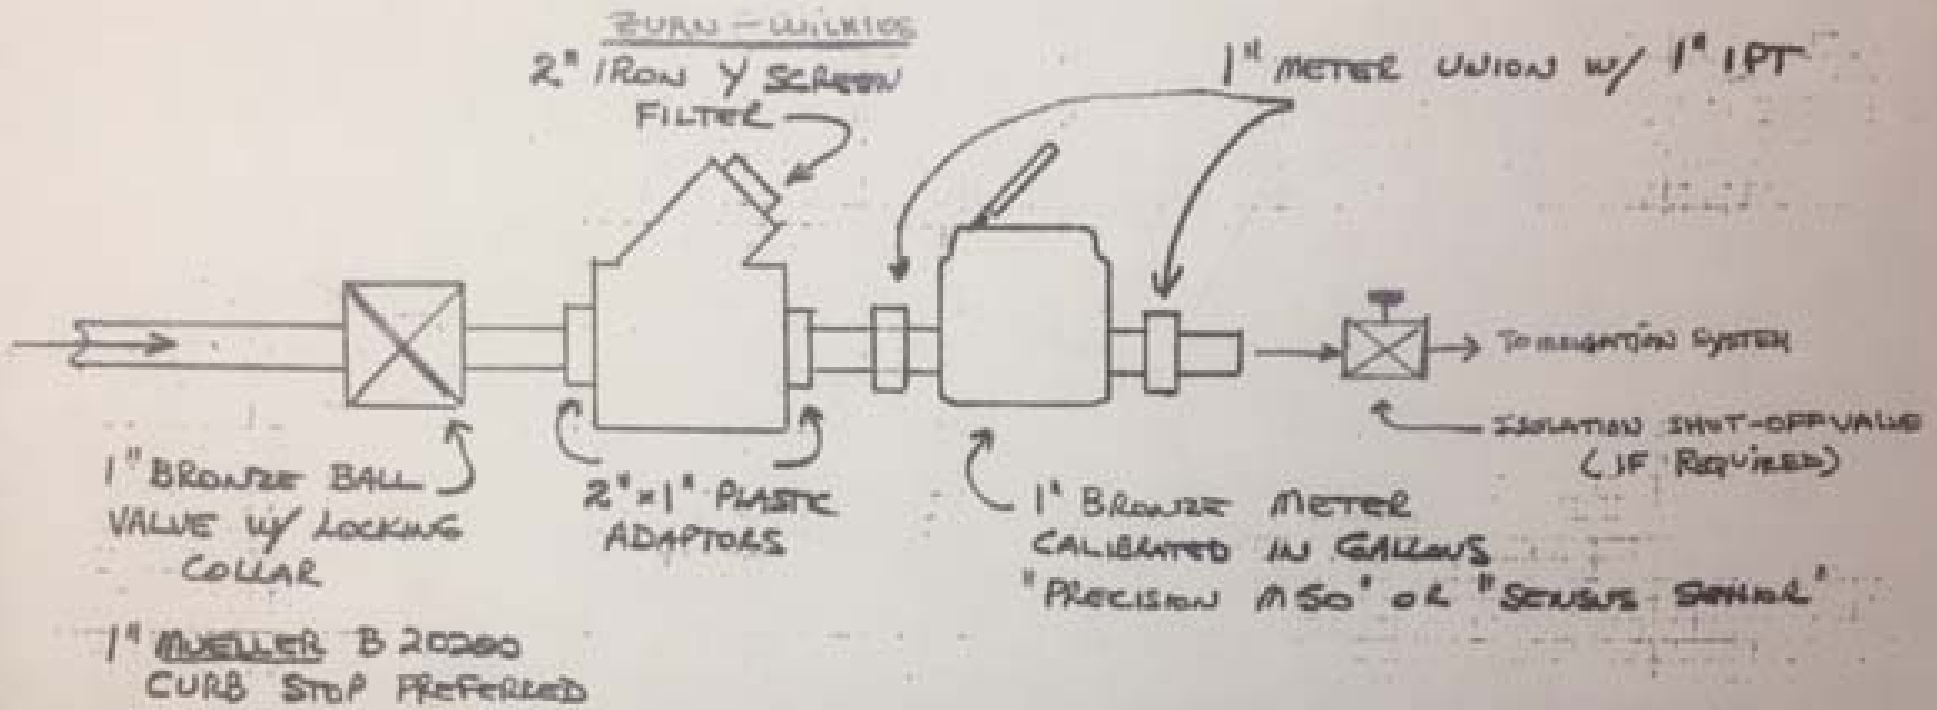

NOTES:

1. INSTALL METER AS CLOSE TO CRCWD MAIN AS IS PRACTICABLE.
2. NO METER BYPASS IS PERMITTED.
3. UNDERGROUND VAULT INSTALLATION OK.
4. CONSIDER PROTECTION FROM FREEZING FOR ABOVE GROUND INSTALLATIONS.
5. A LARGER FILTER IS OK.

CASTLE ROCK COUNTY WATER DISTRICT
STANDARD RETAIL METER