

THE CITY OF NEW YORK  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF WATER POLLUTION CONTROL

BOROUGH OF 51.

CERTIFICATE OF INSPECTION  
NEW SEWER HOUSE CONNECTION

The following described sewer house connection has been laid from the property line to the existing sewer at premises:

N.B.# 760/78 BLOCK 2073 LOT 29

UNDER PERMIT NO. 4330 ISSUED 3-28-80

PREMISES 65 Saybrook St.  
(HOUSE NUMBER AND STREET)

LOCATED EAST SIDE,        FEET SOUTH OF VICTORY BLVD.

OWNER HONEY BEE HOMES Inc.

PLUMBER THURER Plumbing

SIZE AND TYPE OF PIPE LAID 6" CAST Iron

CONN. TO (SIZE, TYPE) 10" ESUP. SEWER LOCATED IN

(STREET/AVENUE) Saybrook St.

I HEREBY CERTIFY THAT I MADE THE INSPECTION OF THE SEWER HOUSE CONNECTION DESCRIBED ABOVE AND THAT ALL WORK DONE UNDER THIS PERMIT HAS BEEN PROPERLY COMPLETED IN ACCORDANCE WITH EXISTING ORDINANCES AND RULES AND REGULATIONS.

DATE: 10/20/78

NAME (PRINT) RICHARD CRESANTE

SIGNED Richard Cresante  
INSPECTOR-DIVISION OF SEWER CONSTRUCTION

NOTED \_\_\_\_\_  
BOROUGH ENGINEER

PENALTY FOR FALSIFICATION:  
FALSIFICATION OF ANY STATEMENT MADE HEREIN IS AN OFFENSE PUNISHABLE BY A FINE OR IMPRISONMENT OR BOTH (N.Y.C. ADMINISTRATIVE CODE, SECTION 1151-9.0)

Copies to: \_\_\_\_\_ Borough Superintendent, Department of Buildings  
\_\_\_\_\_ Borough Office, Bureau of Water Register  
\_\_\_\_\_ Sewer Regulation and Control Section  
File original in Borough Construction Office


NOTE: The sewer to which the house connection is made is  is not  connected to a private sewer treatment plant.

Form No. WPC-15 Rev. B (6-77) [Yellow]

605	Saybrook ST.	2073	29
HOUSE NUMBER	STREET NAME	BLOCK	LOT

1. Was connection extended from existing curb connection?  YES /  NO
2. Was the connection placed on earth, stone or crushed rock, concrete cradle, concrete encasement, or reinforced concrete encasement? (Circle)
3. Was connection made to existing spur or riser or cut in? (Circle)
4. If connection was "cut in", was saddle or dutchman used? (Circle, if yes)
5. Length, size and material of new connection 20' - 6" Cast Iron

6. Depth of connection at curb line is 8' feet.  
 7. All work was exposed and inspected.

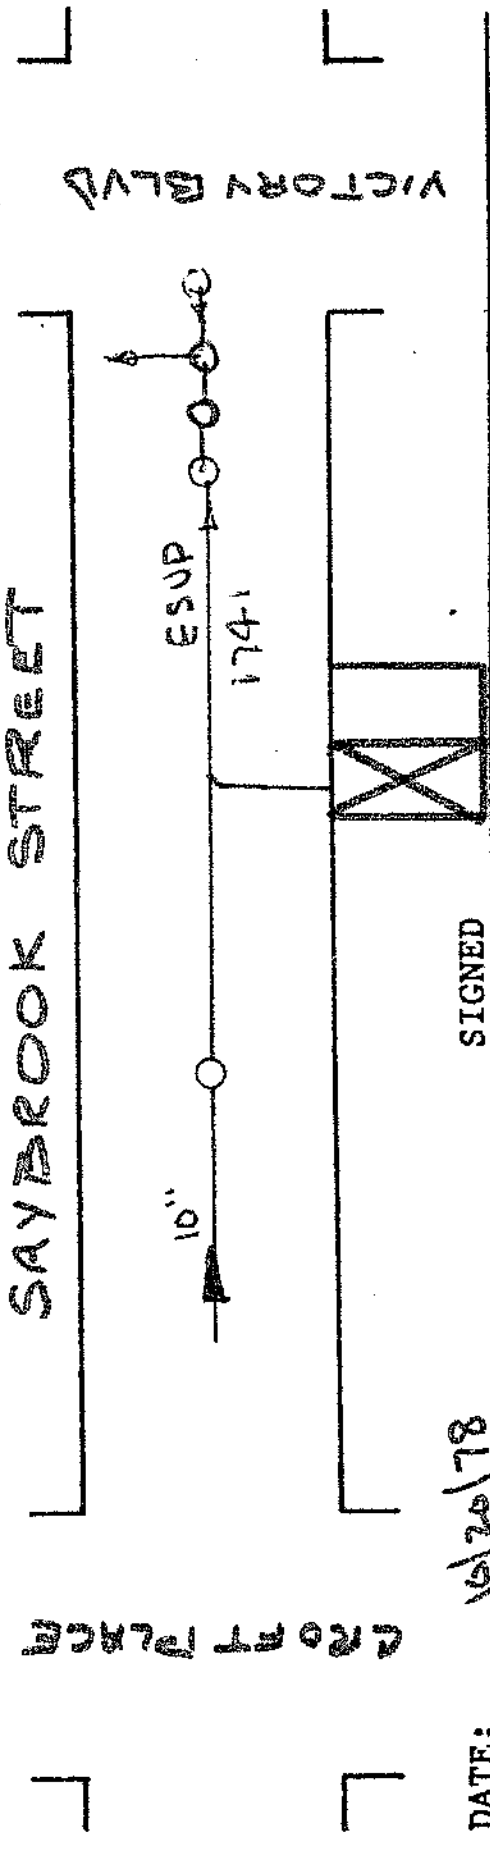

DATE: 10/20/78 SIGNED \_\_\_\_\_  
 INSPECTOR-DIVISION OF SEWER CONSTRUCTION