




East Hampton Airport PFAS Contamination (groundwater and soil)



EH-E SOIL
PFOS/PFOA = 3,780 ppt

**Class B Fire
Suppression Foam**

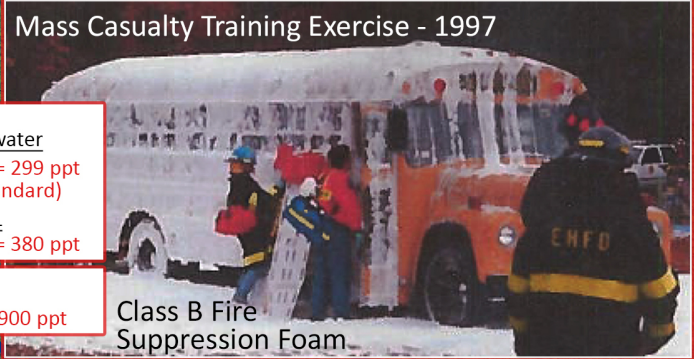

EH-162 Groundwater
PFOS/PFOA = 299 ppt
(4x EPA standard)
SOIL
PFOS/PFOA = 380 ppt

**Class B Fire
Suppression Foam**



EH-B1 Groundwater
PFOS/PFOA = 287 ppt
(4x EPA standard)
SOIL
PFOS/PFOA = 2,250 ppt

**Class B Fire
Suppression Foam**

EH-16 SOIL
PFOS/PFOA = 900 ppt

EH-A1 SOIL
PFOS/PFOA = 520 ppt



**Class B Fire
Suppression Foam**

EH-19A
Fire Dept. Garage (Oshkosh T1500)
Fire District Training Facility, Inc.
Groundwater
PFOS/PFOA = 145 ppt (2x EPA standard)
SOIL: PFOS/PFOA = 4,080 ppt

EH-19A2 Groundwater
PFOS/PFOA = 174 ppt (2x EPA standard)
SOIL: PFOS/PFOA = 370 ppt

EH-19B1 SOIL
PFOS/PFOA = 15,800 ppt

EH-1
Fire Training Structure
Fire District Training, Inc.
Groundwater
PFOS/PFOA = 162 ppt (2x EPA standard)
SOIL: PFOS/PFOA = 10,180 ppt

Storage of Class B Fire Suppression Foam at airport site.
Dates of storage: CURRENTLY STORED Method of storage: 3X55 GALLON DRUM

Prepared by
Si Kinsella
May 8, 2020