

Mesa Cortina Water and Sanitation District

Application for Water and/or Sanitary Sewer Service

Date \_\_\_\_\_

Owner \_\_\_\_\_ Phone H. \_\_\_\_\_ Phone W. \_\_\_\_\_

Owner Address \_\_\_\_\_ State \_\_\_\_\_ Zip \_\_\_\_\_

Owner Billing Address \_\_\_\_\_ State \_\_\_\_\_ Zip \_\_\_\_\_

Project Street Address \_\_\_\_\_

Legal Address Lot \_\_\_\_\_ Block \_\_\_\_\_ Filing \_\_\_\_\_

Starting Date \_\_\_\_\_ Projected Completion Date \_\_\_\_\_

Contractor \_\_\_\_\_ Phone \_\_\_\_\_

Excavation Contractor \_\_\_\_\_ Phone \_\_\_\_\_

Project Sq. Footage \_\_\_\_\_ # Bedrooms \_\_\_\_\_ # Bathrooms \_\_\_\_\_

Water Service Line Size \_\_\_\_\_ Water Meter Size \_\_\_\_\_

Service Lines and Water Meter Inspection Fee \$450.00 Paid \_\_\_\_\_

3/4" Water Meter Assembly \$400.00 Paid \_\_\_\_\_

Your APPLICATION for Water and/or Sanitary Sewer Service dated \_\_\_\_\_ has been approved by the Mesa Cortina Water and Sanitation District on \_\_\_\_\_, subject to payment of all applicable fees and adherence to the Rules and Regulations of the District. You are hereby authorized to connect to the water and/or sanitary sewer system and receive water and/or sewer services from the District system.

District Approval

Owner


Name \_\_\_\_\_ Date \_\_\_\_\_

Name \_\_\_\_\_ Date \_\_\_\_\_

Signature \_\_\_\_\_

Signature \_\_\_\_\_

## MESA CORTINA WATER AND SANITATION DISTRICT RESIDENTIAL 3/4" AND 1" METER ASSEMBLY

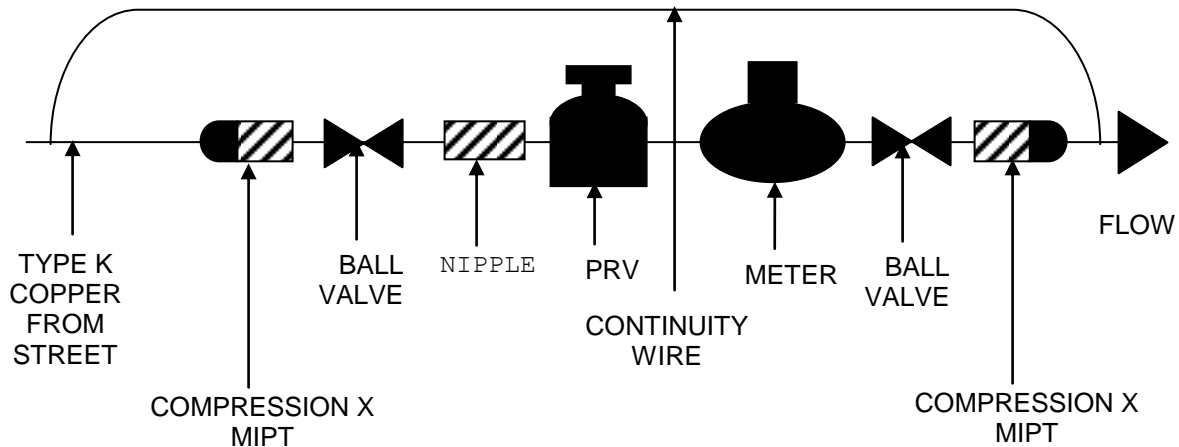

**PARTS SUPPLIED:** (2) compression X MIPT couplings, (2) brass ball valves, (1) 3" brass nipple, (1) pressure reducing valve (PRV), (1) meter yoke, (1) water meter and transponder

The compression X MIPT coupling shall be the first connection made to the type K copper entering the premises. The MIPT is threaded into the first ball valve followed by the 3" brass nipple. The PRV is then threaded between the 3" brass nipple and meter yoke. The second ball valve is then threaded into the meter yoke, which is then followed by the second compression X MIPT coupling. Electrical continuity will be maintained across the entire meter assembly by using a minimum #6 gauge solid copper continuity wire and grounding clamps.

The water meter shall be installed immediately after the service line enters the building. The water meter will be installed in an accessible, heated and lighted location that protects the meter from freezing. The meter shall be installed in a horizontal position.

To schedule an inspection or to ask questions regarding the installation of the water meter assembly please call Water Solutions, Inc. at 970-262-0217. **Inspections require 48 hours prior notice.**