



Energy Testing of a standard TRANE 7.5-Ton RTU

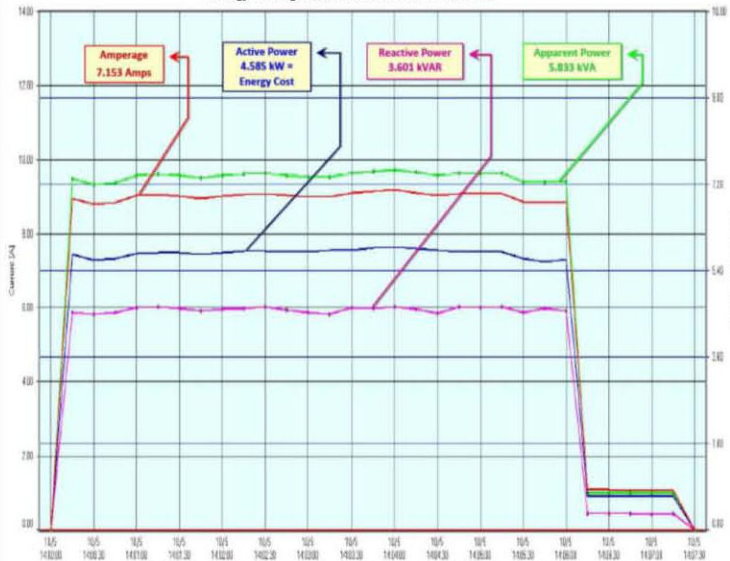

Single Test Segment in Bypass (Normal) Mode

Independent Energy Testing conducted by a major energy producer

Energy Testing of a standard TRANE 7.5-Ton RTU

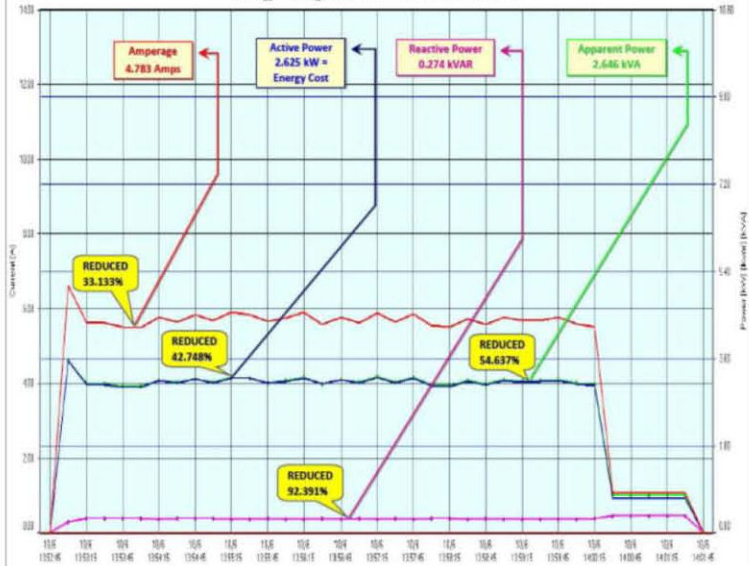

Single Test Segment in Energy Saving Mode

Independent Energy Testing conducted by a major energy producer