

Acoustics — Rating of sound insulation in buildings and of building elements —

Part 1: Airborne sound insulation

The European Standard EN ISO 717-1:1996, with the incorporation of amendment A1:2006, has the status of a British Standard

ICS 91.120.20

National foreword

This British Standard is the English language version of EN ISO 717-1:1996, including amendment A1:2006. It is identical with ISO 717-1:1996. It supersedes BS 5821-1:1984 which is withdrawn.

The start and finish of text introduced or altered by amendment is indicated in the text by tags **A1** **A1**. Tags indicating changes to CEN text carry the number of the amendment. For example, text altered by CEN amendment A1 is indicated in the text by **A1** **A1**.

The UK participation in its preparation was entrusted by Technical Committee EH/1, Acoustics, to Subcommittee EH/1/6, Building acoustics, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

Attention is drawn to the fact that CEN and CENELEC standards normally include an annex which lists normative references to international publications with their corresponding or European publications. The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled “International Standards Correspondence Index”, or by using the “Search” facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

This British Standard, having been prepared under the direction of the Health and Environment Sector Board, was published under the authority of the Standards Board and comes into effect on 15 August 1997

© BSI 2006

ISBN 0 580 28069 1

Amendments issued since publication

Amd. No.	Date	Comments
16718	31 October 2006	See national foreword

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN ISO 717-1

December 1996

+A1

August 2006

ICS 91.120.20

Descriptors: See ISO document

English version

Acoustics — Rating of sound insulation in buildings and of building elements — Part 1: Airborne sound insulation (ISO 717-1:1996)

Acoustique — Evaluation de l'isolement
acoustique des immeubles et des éléments de
construction —
Partie 1: Isolement aux bruits aériens
(ISO 717-1:1996)

Akustik — Bewertung der Schalldämmung in
Gebäuden und von Bauteilen —
Teil 1: Luftschalldämmung
(ISO 717-1:1996)

This European Standard was approved by CEN on 1996-11-30. CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

The European Standards exist in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CEN

European Committee for Standardization
Comité Européen de Normalisation
Europäisches Komitee für Normung

Central Secretariat: rue de Stassart 36, B-1050 Brussels

Foreword

The text of the International Standard ISO 717-1:1996 has been prepared by Technical Committee ISO/TC 43 “Acoustics” in collaboration with Technical Committee CEN/TC 126 “Acoustics properties of building products and of buildings”, the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 1997, and conflicting national standards shall be withdrawn at the latest by June 1997.

ISO 717 consists of two parts under the general title Acoustics — Rating of sound insulation in buildings and of building elements

— *Part 1: Airborne sound insulation;*

— *Part 2: Impact sound insulation.*

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

Endorsement notice

The text of the International Standard ISO 717-1:1996 was approved by CEN as a European Standard without any modification.

NOTE Normative references to International Standards are listed in Annex ZA (normative).

Foreword to amendment A1

This document (EN ISO 717-1:1996/A1:2006) has been prepared by Technical Committee CEN/TC 126 “Acoustic properties of building elements and of buildings”, the secretariat of which is held by AFNOR, in collaboration with Technical Committee ISO/TC 43 “Acoustics”.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by February 2007, and conflicting national standards shall be withdrawn at the latest by February 2007.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

Contents

	Page		Page
Foreword	vi	Table 1 — Single-number quantities of airborne sound insulation properties of building elements	2
Introduction	1	Table 2 — Single-number quantities of airborne sound insulation in buildings	2
1 Scope	1	Table 3 — Reference values for airborne sound	4
2 Normative references	1	Table 4 — Sound level spectra to calculate the adaptation terms	7
3 Definitions	1	Table A.1 — Relevant spectrum adaptation term for different types of noise source	10
4 Procedure for evaluating single-number quantities	2	Table B.1 — Sound level spectra to calculate the adaptation terms for enlarged frequency range	11
5 Statement of results	8	Table C.1 — Measurements in the specified frequency range 100 Hz to 3 150 Hz	14
Annex A (informative) Use of spectrum adaptation terms	9	Table C.2 — Measurements in the enlarged frequency range 50 Hz to 5 000 Hz	15
Annex B (informative) Terms and spectra for an enlarged frequency range	10		
Annex C (informative) Examples of the calculation of single-number quantities and spectrum adaptation terms	13		
Annex ZA (normative) Normative references to international publications with their relevant European publications	17		
Bibliography	16		
Figure 1 — Curve of reference values for airborne sound, one-third-octave bands	3		
Figure 2 — Curve of reference values for airborne sound, octave bands	3		
Figure 3 — Sound level spectra to calculate the spectrum adaptation terms for one-third-octave band measurements	5		
Figure 4 — Sound level spectra to calculate the spectrum adaptation terms for octave-band measurements	6		
Figure B.1 — Sound level spectra to calculate the spectrum adaptation terms for measurements using one-third-octave bands	12		
Figure B.2 — Sound level spectra to calculate the spectrum adaptation terms for measurements using octave bands	13		

INTERNATIONAL
STANDARD

ISO
717-1

Second edition
1996-12-15

**Acoustics — Rating of sound insulation in
buildings and of building elements —**

**Part 1:
Airborne sound insulation**

*Acoustique — Évaluation de l'isolement acoustique des immeubles et des
éléments de construction —*

Partie 1: Isolement aux bruits aériens



Reference number
ISO 717-1:1996(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 717-1 was prepared by Technical Committee ISO/TC 43, *Acoustics*, Subcommittee SC 2, *Building acoustics*.

This second edition of ISO 717-1 cancels and replaces ISO 717-1:1982 and ISO 717-3:1982, which have been technically revised.

ISO 717 consists of the following parts, under the general title

Acoustics — Rating of sound insulation in buildings and of building elements

— *Part 1: Airborne sound insulation;*

— *Part 2: Impact sound insulation.*

Annex A, Annex B and Annex C of this part of ISO 717 are for information only.

Descriptors: Acoustics, buildings, building elements, airborne sound, acoustic insulation, ratings, acoustic measurements.

Introduction

Methods of measurement of airborne sound insulation of building elements and in buildings have been standardized in ISO 140-3, ISO 140-4, ISO 140-5, ISO 140-9 and ISO 140-10. The purpose of this part of ISO 717 is to standardize a method whereby the frequency-dependent values of airborne sound insulation can be converted into a single number characterizing the acoustical performance.

1 Scope

This part of ISO 717

- a) defines single-number quantities for airborne sound insulation in buildings and of building elements such as walls, floors, doors and windows;
- b) takes into consideration the different sound level spectra of various noise sources such as noise sources inside a building and traffic outside a building; and
- c) gives rules for determining these quantities from the results of measurements carried out in one-third-octave or octave bands in accordance with ISO 140-3, ISO 140-4, ISO 140-5, ISO 140-9 and ISO 140-10.

The single-number quantities in accordance with this part of ISO 717 are intended for rating the airborne sound insulation and for simplifying the formulation of acoustical requirements in building codes. The required numerical values of the single-number quantities are specified according to varying needs. The single-number quantities are based on results of measurements in one-third-octave bands or octave bands.

For laboratory measurements made in accordance with ISO 140-3, ISO 140-9 and ISO 140-10, single-number quantities should be calculated using one-third-octave bands only.

The rating of results of measurements carried out over an enlarged frequency range is dealt with in Annex B.

2 Normative references

The following standards contain provisions which, through reference in this text, constitute provisions of this part of ISO 717. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this part of ISO 717 are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

ISO 140-3:1995, *Acoustics — Measurement of sound insulation in buildings and of building elements — Part 3: Laboratory measurements of airborne sound insulation of building elements*.

A_1 ISO 140-4:1998 A_1 , *Acoustics — Measurement of sound insulation in buildings and of building elements — Part 4: Field measurements of airborne sound insulation between rooms*.

A_1 ISO 140-5:1998 A_1 , *Acoustics — Measurement of sound insulation in buildings and of building elements — Part 5: Field measurements of airborne sound insulation of façade elements and façades*.

ISO 140-9:1985, *Acoustics — Measurement of sound insulation in buildings and of building elements — Part 9: Laboratory measurement of room-to-room airborne sound insulation of a suspended ceiling with a plenum above it*.

ISO 140-10:1991, *Acoustics — Measurement of sound insulation in buildings and of building elements — Part 10: Laboratory measurement of airborne sound insulation of small building elements*.

3 Definitions

For the purposes of this part of ISO 717, the following definitions apply.

3.1 single-number quantity for airborne sound insulation rating

value, in decibels, of the reference curve at 500 Hz after shifting it in accordance with the method specified in this part of ISO 717

NOTE 1 Terms and symbols for the single-number quantity used depend on the type of measurement. They are listed in Table 1 for airborne sound insulation properties of building elements and in Table 2 for airborne sound insulation in buildings. In general, new single-number quantities are derived in a similar way.

A_1 Footnotes deleted A_1

3.2 spectrum adaptation term

value, in decibels, to be added to the single-number rating (e.g. R_w) to take account of the characteristics of particular sound spectra

NOTE 2 Two sound spectra are defined (in one-third-octave bands and in octave bands) in this part of ISO 717.

NOTE 3 Annex A gives information on the purpose of introducing these two spectrum adaptation terms.

4 Procedure for evaluating single-number quantities

4.1 General

The values obtained in accordance with ISO 140-3, ISO 140-4, ISO 140-5, ISO 140-9 and ISO 140-10 are compared with reference values (see 4.2) at the frequencies of measurement within the range 100 Hz to 3 150 Hz for one-third-octave bands and 125 Hz to 2 000 Hz for octave bands.

The comparison shall be carried out as specified in 4.4

Furthermore, two spectrum adaptation terms shall be calculated (see 4.5) based on two typical spectra within the frequency range as quoted above. These two terms may optionally be supplemented by additional spectrum adaptation terms covering (if need be and if measured data are available) a wider frequency range between 50 Hz and 5 000 Hz.

4.2 Reference values

The set of reference values used for comparison with measurement results shall be as given in Table 3. The reference curves are shown in Figure 1 and Figure 2.

4.3 Sound spectra

The set of sound spectra in one-third-octave bands and octave bands to calculate the spectrum adaptation terms shall be as given in Table 4 and shown in Figure 3 and Figure 4. The spectra are A-weighted and the overall spectrum level is normalized to 0 dB.

Table 1 — Single-number quantities of airborne sound insulation properties of building elements

Derived from one-third-octave band values		Defined in	
Single-number quantity	Term and symbol		
Weighted sound reduction index, R_w	Sound reduction index, R	ISO 140-3:1995	equation (4)
Weighted suspended-ceiling normalized level difference, $D_{n,c,w}$	Suspended-ceiling normalized level difference, $D_{n,c}$	ISO 140-9:1985	equation (3)
Weighted element-normalized level difference, $D_{n,e,w}$	Element-normalized level difference, $D_{n,e}$	ISO 140-10:1991	equation (1)

Table 2 — Single-number quantities of airborne sound insulation in buildings

Derived from one-third-octave or octave-band values		Defined in	
Single-number quantity	Term and symbol		
Weighted apparent sound reduction index, R'_w	Apparent sound reduction index, R'	ISO 140-4:—	equation (5)
Weighted apparent sound reduction index, $R'_{45^\circ,w}$	Apparent sound reduction index, R'_{45°	ISO 140-5:—	equation (3)
Weighted apparent sound reduction index, $R'_{tr,s,w}$	Apparent sound reduction index, $R'_{tr,s}$	ISO 140-5:—	equation (4)
Weighted normalized level difference, $D_{n,w}$	Normalized level difference, D_n	ISO 140-4:—	equation (3)
Weighted standardized level difference, $D_{nT,w}$	Standardized level difference, D_{nT}	ISO 140-4:—	equation (4)
Weighted standardized level difference, $D_{ls,2m,nT,w}$ or $D_{tr,2m,nT,w}$	Standardized level difference, $D_{ls,2m,nT}$ or $D_{tr,2m,nT}$	ISO 140-5:—	equation (7)

Licensed copy: Southampton University User, University of Southampton, Version correct as of 05/03/2011 23:48, (c)

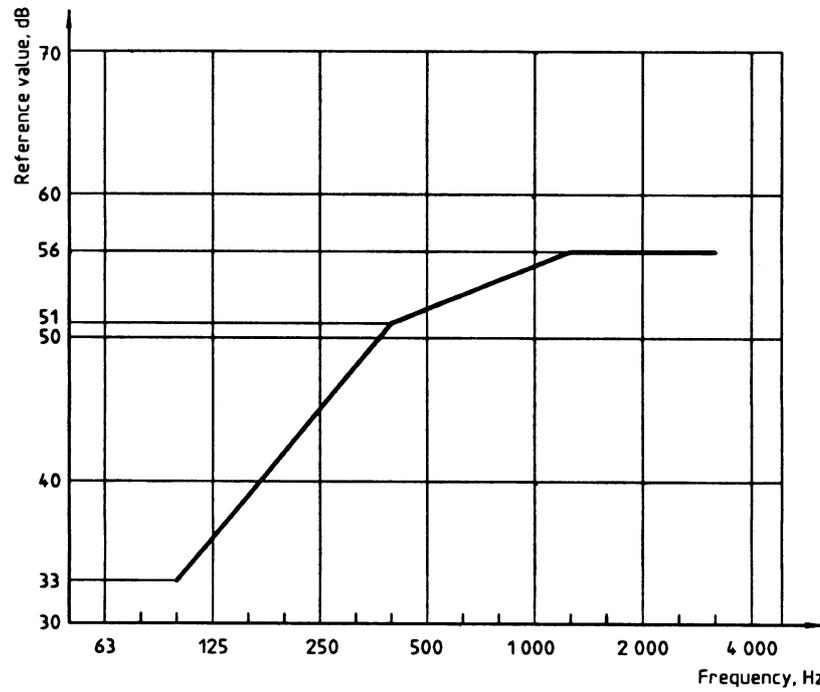


Figure 1 — Curve of reference values for airborne sound, one-third-octave bands


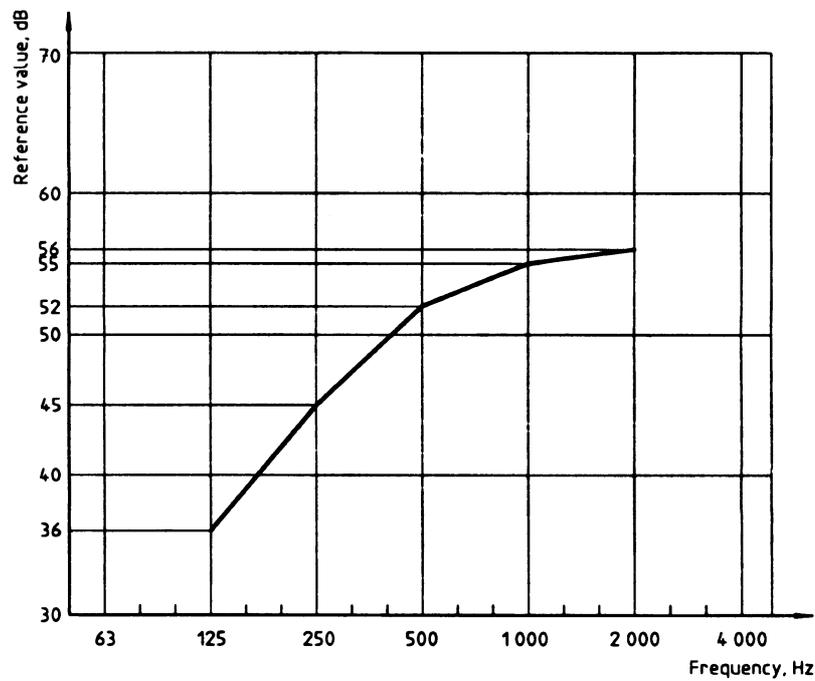


Figure 2 — Curve of reference values for airborne sound, octave bands

Table 3 — Reference values for airborne sound

Frequency Hz	Reference values, dB	
	One-third-octave bands	Octave bands
100	33	
125	36	36
160	39	
200	42	
250	45	45
315	48	
400	51	
500	52	52
630	53	
800	54	
1 000	55	55
1 250	56	
1 600	56	
2 000	56	56
2 500	56	
3 150	56	

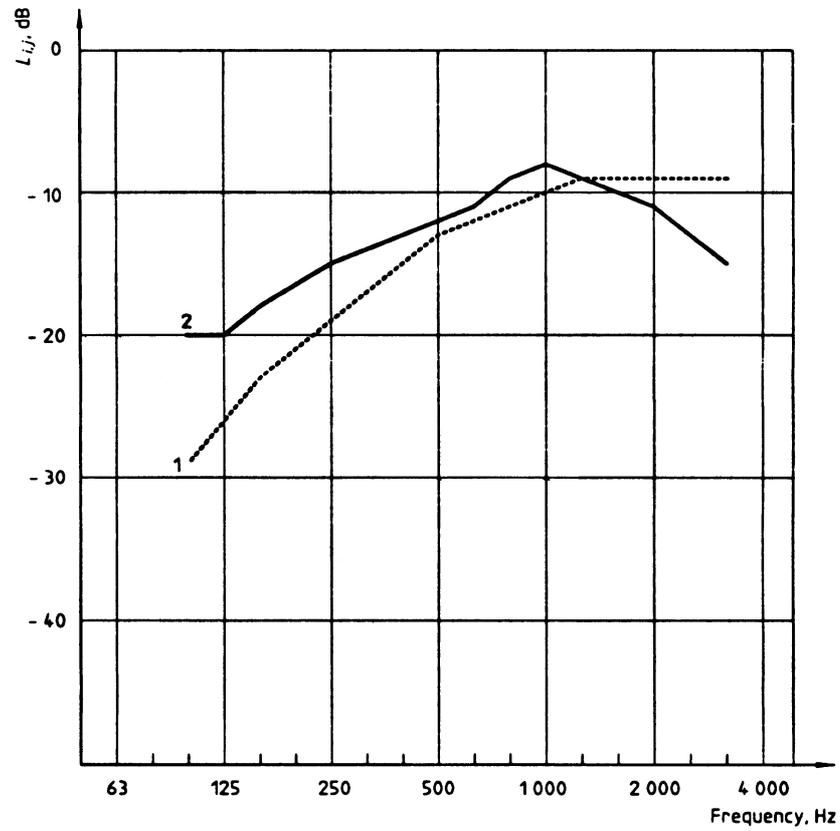

Key

- Spectrum No. 1 to calculate C
- Spectrum No. 2 to calculate C_{1r}

Figure 3 — Sound level spectra to calculate the spectrum adaptation terms for one-third-octave band measurements

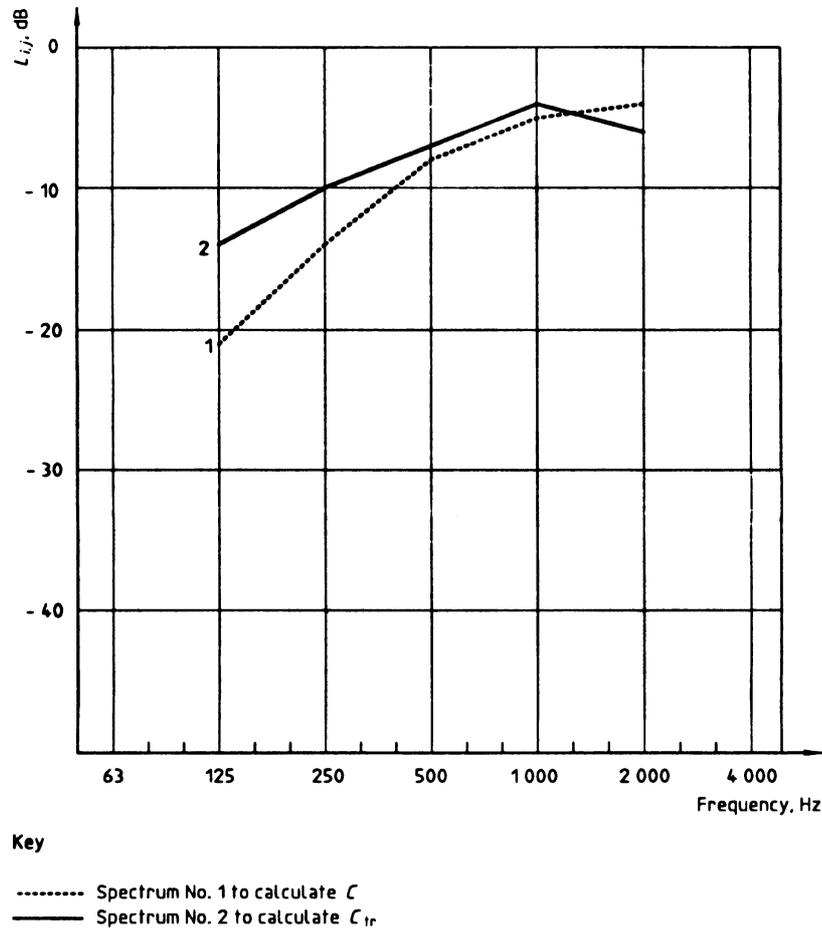


Figure 4 — Sound level spectra to calculate the spectrum adaptation terms for octave-band measurements

Table 4 — Sound level spectra to calculate the adaptation terms

Frequency Hz	Sound levels, L_{ij} , dB			
	Spectrum No. 1 to calculate C		Spectrum No. 2 to calculate C_{tr}	
	One-third octave	Octave	One-third octave	Octave
100	-29		-20	
125	-26	-21	-20	-14
160	-23		-18	
200	-21		-16	
250	-19	-14	-15	-10
315	-17		-14	
400	-15		-13	
500	-13	-8	-12	-7
630	-12		-11	
800	-11		-9	
1 000	-10	-5	-8	-4
1 250	-9		-9	
1 600	-9		-10	
2 000	-9	-4	-11	-6
2 500	-9		-13	
3 150	-9		-15	

NOTE All levels are A-weighted and the overall spectrum level is normalized to 0 dB.

4.4 Method of comparison

A₁ To evaluate the results of a measurement made in accordance with ISO 140-3, ISO 140-4, ISO 140-5, ISO 140-9 and ISO 140-10 in one-third-octave bands (or octave bands), the measurement data shall be given to one decimal place¹⁾. Shift the relevant reference curve in increments of 1 dB towards the measured curve until the sum of unfavourable deviations is as large as possible but not more than 32,0 dB (measurement in 16 one-third-octave bands) or 10,0 dB (measurement in 5 octave bands). **A₁**

An unfavourable deviation at a particular frequency occurs when the result of measurements is less than the reference value. Only the unfavourable deviations shall be taken into account.

The value, in decibels, of the reference curve at 500 Hz, after shifting it in accordance with this procedure, is R_w , R'_w , $D_{n,w}$ or $D_{nT,w}$, etc. (see Table 1 and Table 2).

Only use reference values in octave bands for comparison with results of measurements in octave bands in the field.

4.5 Calculation of spectrum adaptation terms

The spectrum adaptation terms, C_j , in decibels, shall be calculated with the sound spectra given in 4.3 from the following equation:

$$C_j = X_{Aj} - X_w$$

where

j is the index for the sound spectra Nos. 1 and 2;

X_w is the single-number quantity calculated according to 4.4 from R , R' , D_n or D_{nT} values;

X_{Aj} is calculated from

$$X_{Aji} = -10 \lg \sum 10^{(L_{ij} - X_i)/10} \text{ dB}$$

A₁ ¹⁾ The different parts of ISO 140 state that the results shall be reported "to one decimal place". However, if the octave or one-third-octave values have been reported with more than one decimal digit, the values shall be reduced to one decimal place before use in the calculation of the single number rating. This is done by taking the value in tenths of dB closest to the reported values: XX.XYZZZ... is rounded to XX,X if Y is less than 5 and to XX,X + 0,1 if Y is equal to or greater than 5. Software developers should ensure that this reduction applies to the true input values and not only to the displayed precision (as shown on the screen or printed on paper). Generally this can be implemented by the following sequence of instructions: multiply the (positive) number XX.XYZZZ... by 10 and add 0,5, take the integer part and then divide the result by 10. For further details see ISO 31-0. **A₁**

where

- i is the index for the one-third-octave bands 100 Hz to 3 150 Hz or the octave bands 125 Hz to 2 000 Hz;
- L_{ij} are the levels as given in 4.3 at the frequency i for the spectrum j ;
- X_i the sound reduction index, R_i , or apparent sound reduction index, R'_i , or normalized sound level difference, $D_{n,i}$, or standardized sound level difference, $D_{nT,i}$, at the measuring frequency, i , given to one decimal place.

Calculate the quantity, X_{Aj} , with sufficient accuracy and round the result to an integer²⁾. The resulting spectrum adaptation term is an integer by definition and shall be identified in accordance with the spectrum used, as follows: A_1

- C when calculated with spectrum No. 1 (A-weighted pink noise);
- C_{tr} when calculated with spectrum No. 2 (A-weighted urban traffic noise).

NOTE 4 The spectra of most of the usual prevailing indoor and outdoor noise sources lie in the range of spectra Nos. 1 and 2; the spectrum adaptation terms C and C_{tr} may therefore be used to characterize the sound insulation with respect to many types of noise. Guidelines for the relevant spectrum adaptation terms are given in Annex A.

NOTE 5 Supplementary calculations of the spectrum adaptation terms may also be carried out for the enlarged frequency range (including 50 Hz + 63 Hz + 80 Hz and/or 4 000 Hz + 5 000 Hz one-third-octave bands or 63 Hz and/or 4 000 Hz octave bands). The relevant terms and spectra are given in Annex B. An example of the calculation of the single-number quantity and the adaptation terms is given in Annex C.

5 Statement of results

The appropriate single-number quantity R_w , R'_w , $D_{n,w}$ or $D_{nT,w}$ and both adaptation terms shall be given with reference to this part of ISO 717.

5.1 Statement of performance of building elements

Calculate the single-number quantity from one-third-octave bands only. State the two spectrum adaptation terms in parentheses after the single-number quantity, separated by a semicolon.

EXAMPLE

$$R_w (C; C_{tr}) = 41 (0; -5) \text{ dB}$$

5.2 Statement of requirements and of performance of buildings

Requirements shall be given with the single-number quantity according to 4.2 and 4.4 or be based on the sum of this value and the relevant spectrum adaptation term.

EXAMPLES

$$R'_w + C_{tr} \geq 45 \text{ dB (e.g. for façades)}$$

or

$$D_{nT,w} + C \geq 54 \text{ dB (e.g. between dwellings)}$$

The acoustic performance of buildings shall be given in the relevant terms according to the requirements (see Annex A).

For field measurements in accordance with ISO 140-4 or ISO 140-5, it shall be stated whether the single-number quantity is calculated from measuring results in one-third-octave bands or octave bands. In general, there may be differences between single-number quantities calculated from one-third-octave- or octave-band measurements of about ± 1 dB.

²⁾ $XX.YZZZ\dots$ is rounded to XX if Y is less than 5 and to $XX + 1$ if Y is greater than or equal to 5. For further details see ISO 31-0. Software implementers should be aware that calculation of the spectrum adaptation terms involves floating-point calculations that are never exact and may incur rounding errors. In some rare cases this may lead to a difference of +1 dB or -1 dB in the final result. In order to avoid rounding errors, it is strongly recommended to use the highest possible machine accuracy available for floating-point representation and mathematical operations. A_1

Annex A (informative)

Use of spectrum adaptation terms

NOTE 6 The spectrum adaptation terms C and C_{tr} have been introduced in this second edition of ISO 717-1 (which now includes the former ISO 717-3) to take into account different spectra of noise sources (such as pink noise and road traffic noise) and to assess sound insulation curves with very low values in a single frequency band. (The validity of the rating obtained with the reference curve alone is limited for such cases.) The spectrum adaptation term in this sense replaces the 8 dB rule used in the first edition of ISO 717-1. C and C_{tr} have not been included as one single-number quantity but have been included as separate numbers. This is to ensure continuity with the reference curve system and to avoid the danger of confusion of different single-number quantities of about the same magnitude. Furthermore, interlaboratory tests have shown that the reproducibility of the single-number quantity based on the reference curve is somewhat better.

A.1 Spectrum adaptation term C

The spectrum adaptation term C is defined in 4.5 as

$$C = X_{A,1} - X_w$$

where

$X_{A,1}$ characterizes the difference between the A-weighted sound levels in the source room and the receiving room, for pink noise (spectrum No.1) in the source room;

X_w is the relevant single-number quantity based on the reference curve.

NOTE 7 In several countries, when using pink noise as a sound source,

$$R_{A,1} = R_w + C$$

is used as R_A (the sound reduction index) and

$$D_{nT,A,1} = D_{nT,w} + C$$

is used as $D_{nT,A}$ (the standardized level difference).

Generally, C is approximately -1 , however, when there is a dip in the sound insulation curve in a single frequency band, C will become < -1 . When comparing constructions, it may therefore be appropriate to consider both R_w and C .

In setting requirements, it may be appropriate to base these on the sum of X_w and C , as stated in 5.2.

A.2 Spectrum adaptation term C_{tr}

The spectrum adaptation term C_{tr} is defined in 4.5 as

$$C_{tr} = X_{A,2} - X_w$$

where

$X_{A,2}$ characterizes the difference between the A-weighted levels in the source room (or open air in front of the façade) and in the receiving room, for road traffic noise (spectrum No.2);

X_w is the relevant single-number quantity based on the reference curve.

NOTE 8 In several countries, when using traffic noise as a source signal,

$$R_{A,2} = R_w + C_{tr}$$

is used instead of $R_{A,tr}$ (the sound reduction index) and

$$D_{nT,A,2} = D_{nT,w} + C_{tr}$$

is used instead of $D_{nT,A,tr}$ (the sound insulation).

Generally, for different makes of window having the same basic construction, the numerical value of the term C_{tr} will be almost the same; in such cases it may be appropriate to use R_w for rating purposes. However, when comparing very different types of constructions, both R_w and C_{tr} should be considered.

Table A.1 — Relevant spectrum adaptation term for different types of noise source

Type of noise source	Relevant spectrum adaptation term
Living activities (talking, music, radio, tv) Children playing Railway traffic at medium and high speed ^a Highway road traffic > 80 km/h ^a Jet aircraft, short distance Factories emitting mainly medium and high frequency noise	C (spectrum No. 1)
Urban road traffic Railway traffic at low speeds ^a Aircraft, propeller driven Jet aircraft, large distance Disco music Factories emitting mainly low and medium frequency noise	C_{tr} (spectrum No. 2)
^a In several European countries, calculation models for highway road traffic noise and railway noise exist, which define octave band levels; these could be used for comparison with spectra Nos. 1 and 2.	

Requirements may be based on the sum of X_w and C_{tr} as stated in 5.2. An estimation of the A-weighted indoor level from the known A-weighted traffic noise level in front of the façade should be based on $X_w + C_{tr}$.

A.3 Application of the spectrum adaptation terms to additional types of noise

In Table 1, a number of different noise sources is attached to the spectrum adaptation terms C and C_{tr} .

This may be used as guidelines for the application of the spectrum adaptation terms to assess the sound insulation with respect to these noise sources. If the A-weighted spectrum of a certain type of noise is known, it can be compared with the data in Table 4 and Figure 3 and Figure 4 and the relevant adaptation term may be chosen.

Annex B (informative)

Terms and spectra for an enlarged frequency range

When measurements have been carried out for an enlarged frequency range, additional spectrum adaptation terms may be calculated and stated for this frequency range. The frequency range has to be stated in the index of C or C_{tr} .

EXAMPLES

$$C_{50-3150} \text{ or } C_{50-5000} \text{ or } C_{100-5000}$$

$$C_{tr,50-3150} \text{ or } C_{tr,50-5000} \text{ or } C_{tr,100-5000}$$

In the statement of results, these additional adaptation terms may be given as follows:

$$R_w(C; C_{tr}; C_{50-3150}; C_{tr,50-3150}) = 41 (0; -5; -1; -4) \text{ dB}$$


The sound spectra in one-third-octave bands and in octave bands for the enlarged frequency range are specified in Table B.1 and shown in Figure B.1 and Figure B.2. The spectra, like those in Table 4, are A-weighted and the overall spectrum level is normalized to 0 dB.

NOTE 9 Because of the normalization to 0 dB, the absolute values for the enlarged frequency ranges 50 Hz to 5 000 Hz and 100 Hz to 5 000 Hz for spectrum No.1 differ by 1 dB from those given for the frequency range 100 Hz to 3 150 Hz in Table 4.

Table B.1 — Sound level spectra to calculate the adaptation terms for enlarged frequency range

Frequency Hz	Sound levels, L_{ij} , dB					
	Spectrum No.1 to calculate				Spectrum No.2 to calculate C_{tr} for any frequency range	
	$C_{50-3150}$		$C_{50-5000}$ and $C_{100-5000}$		One-third octave	Octave
One-third octave	Octave	One-third octave	Octave			
50	-40		-41		-25	
63	-36	-31	-37	-32	-23	-18
80	-33		-34		-21	
100	-29		-30		-20	
125	-26	-21	-27	-22	-20	-14
160	-23		-24		-18	
200	-21		-22		-16	
250	-19	-14	-20	-15	-15	-10
315	-17		-18		-14	
400	-15		-16		-13	
500	-13	-8	-14	-9	-12	-7
630	-12		-13		-11	
800	-11		-12		-9	
1 000	-10	-5	-11	-6	-8	-4
1 250	-9		-10		-9	
1 600	-9		-10		-10	
2 000	-9	-4	-10	-5	-11	-6
2 500	-9		-10		-13	
3 150	-9		-10		-15	
4 000			-10	-5	-16	-11
5 000			-10		-18	


NOTE All levels are A-weighted and the overall spectrum level is normalized to 0 dB.

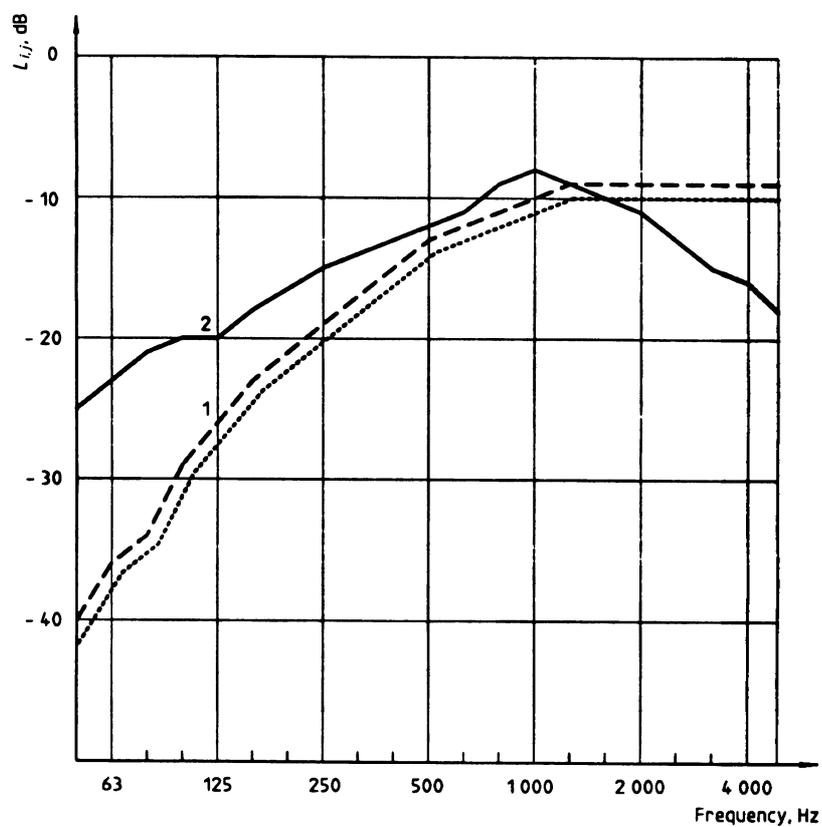

Key

- Spectrum No. 1 to calculate C_1 :
- 50 Hz to 5 000 Hz and 100 Hz to 5 000 Hz
- 50 Hz to 3 150 Hz
- Spectrum No. 2 to calculate C_{1r}

Figure B.1 — Sound level spectra to calculate the spectrum adaptation terms for measurements using one-third-octave bands

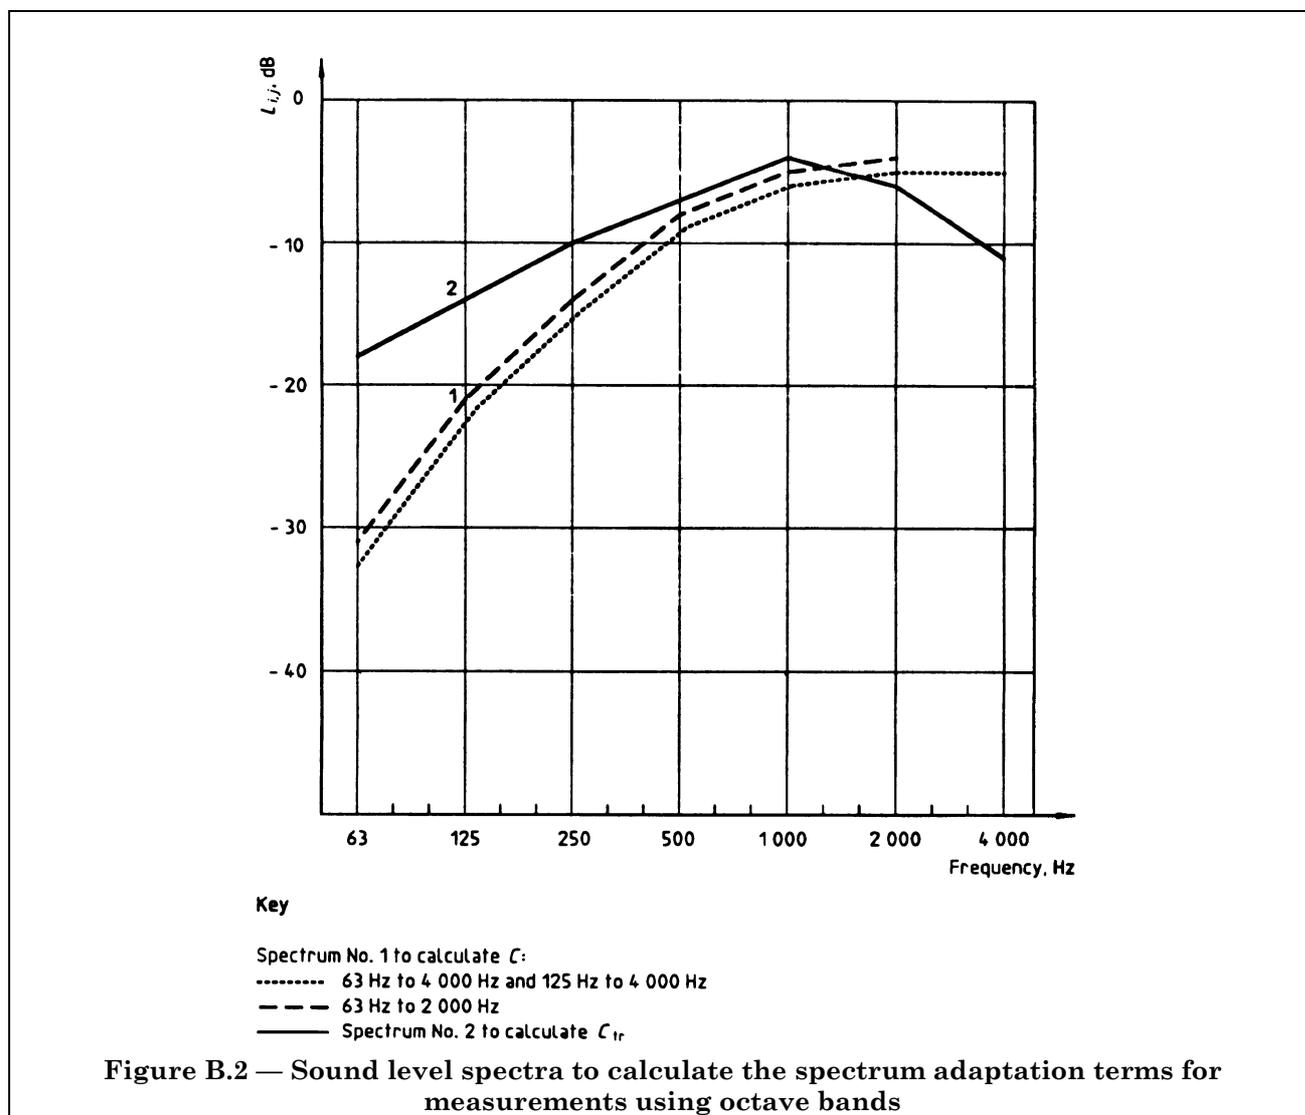

Annex C (informative)

Examples of the calculation of single-number quantities and spectrum adaptation terms

Table C.1 and Table C.2 show examples of the evaluation of the single-number quantities and spectrum adaptation terms based on the results of the measurement of the sound reduction index of a building element in a laboratory. The results may be stated as

$$R_w(C; C_{tr}) = 30(-2; -3) \text{ dB or}$$

$$R_w(C; C_{tr}; C_{50-5000}; C_{tr,50-5000}) = 30(-2; -3; -2; -4) \text{ dB}$$

A1

Table C.1 — Measurements in the specific frequency range 100 Hz to 3 150 Hz

Frequency Hz	R_i dB	Reference values shifted by - 22 dB dB	Unfavourable deviation dB	Spectrum No. 1 dB	$L_{i1} - R_i$ dB	$10^{(L_{i1} - R_i)/10}$ $\times 10^{-5}$	Spectrum No. 2 dB	$L_{i2} - R_i$ dB	$10^{(L_{i2} - R_i)/10}$ $\times 10^{-5}$
100	20,4	11	—	- 29	- 49,4	1,148...	- 20	- 40,4	9,120...
125	16,3	14	—	- 26	- 42,3	5,888...	- 20	- 36,3	23,442...
160	17,7	17	—	- 23	- 40,7	8,511...	- 18	- 35,7	26,915...
200	22,6	20	—	- 21	- 43,6	4,365...	- 16	- 38,6	13,803...
250	22,4	23	0,6	- 19	- 41,4	7,244...	- 15	- 37,4	18,197...
315	22,7	26	3,3	- 17	- 39,7	10,715...	- 14	- 36,7	21,379...
400	24,8	29	4,2	- 15	- 39,8	10,471...	- 13	- 37,8	16,595...
500	26,6	30	3,4	- 13	- 39,6	10,964...	- 12	- 38,6	13,803...
630	28,0	31	3,0	- 12	- 40,0	10,000	- 11	- 39,0	12,589...
800	30,5	32	1,5	- 11	- 41,5	7,079...	- 9	- 39,5	11,220...
1 000	31,8	33	1,2	- 10	- 41,8	6,606...	- 8	- 39,8	10,471...
1 250	32,5	34	1,5	- 9	- 41,5	7,079...	- 9	- 41,5	7,079...
1 600	33,4	34	0,6	- 9	- 42,4	5,754...	- 10	- 43,4	4,570...
2 000	33,0	34	1,0	- 9	- 42,0	6,309...	- 11	- 44,0	3,981...
2 500	31,0	34	3,0	- 9	- 40,0	10,000	- 13	- 44,0	3,981...
3 150	25,5	34	8,5	- 9	- 34,5	35,481...	- 15	- 40,5	8,912...
sum = 31,8 < 32 $R_w = 52 - 22 \text{ dB} = 30 \text{ dB}$				sum = 147,6199... $\times 10^{-5}$ - 10 lg sum = 28,308... $C = 28 - 30 \text{ dB} = - 2 \text{ dB}$			sum = 206,0636... $\times 10^{-5}$ - 10 lg sum = 26,859... $C_{tr} = 27 - 30 \text{ dB} = - 3 \text{ dB}$		

A1

Licensed copy: Southampton University User, University of Southampton, Version correct as of 05/03/2011 23:48, (c)

A1

Table C.2 — Measurements in the enlarged frequency range 50 Hz to 5 000 Hz

Frequency	R_i	Reference values shifted by - 22 dB	Unfavourable deviation	Spectrum No. 1	$L_{i1} - R_i$	$10^{(L_{i1} - R_i)/10}$	Spectrum No. 2	$L_{i2} - R_i$	$10^{(L_{i2} - R_i)/10}$
Hz	dB	dB	dB	dB	dB	10^{-5}	dB	dB	10^{-5}
50	18,7			- 41	- 59,7	0,107...	- 25	- 43,7	4,265...
63	19,2			- 37	- 56,2	0,239...	- 23	- 42,2	6,025...
80	20,0			- 34	- 54,0	0,398...	- 21	- 41,0	7,943...
100	20,4	11		- 30	- 50,4	0,912...	- 20	- 40,4	9,120...
125	16,3	14		- 27	- 43,3	4,677...	- 20	- 36,3	23,442...
160	17,7	17		- 24	- 41,7	6,760...	- 18	- 35,7	26,915...
200	22,6	20		- 22	- 44,6	3,467...	- 16	- 38,6	13,803...
250	22,4	23	0,6	- 20	- 42,4	5,754...	- 15	- 37,4	18,197...
315	22,7	26	3,3	- 18	- 40,7	8,511...	- 14	- 36,7	21,379...
400	24,8	29	4,2	- 16	- 40,8	8,317...	- 13	- 37,8	16,595...
500	26,6	30	3,4	- 14	- 40,6	8,709...	- 12	- 38,6	13,803...
630	28,0	31	3,0	- 13	- 41,0	7,943...	- 11	- 39,0	12,589...
800	30,5	32	1,5	- 12	- 42,5	5,623...	- 9	- 39,5	11,220...
1 000	31,8	33	1,2	- 11	- 42,8	5,248...	- 8	- 39,8	10,471...
1 250	32,5	34	1,5	- 10	- 42,5	5,623...	- 9	- 41,5	7,079...
1 600	33,4	34	0,6	- 10	- 43,4	4,570...	- 10	- 43,4	4,570...
2 000	33,0	34	1,0	- 10	- 43,0	5,011...	- 11	- 44,0	3,981...
2 500	31,0	34	3,0	- 10	- 41,0	7,943...	- 13	- 44,0	3,981...
3 150	25,5	34	8,5	- 10	- 35,5	28,183...	- 15	- 40,5	8,912...
4 000	26,8			- 10	- 36,8	20,893...	- 16	- 42,8	5,248...
5 000	29,2			- 10	- 39,2	12,022...	- 18	- 47,2	1,905...
	sum = 31,8 < 32 $R_w = 52 - 22 \text{ dB} = 30 \text{ dB}$			sum = 150,9194... $\times 10^{-5}$ - 10 lg sum = 28,212... $C = 28 - 30 \text{ dB} = - 2 \text{ dB}$			sum = 231,4518... $\times 10^{-5}$ - 10 lg sum = 26,355... $C_{tr} = 26 - 30 \text{ dB} = - 4 \text{ dB}$		

A1

Bibliography

[1] ISO 31-0, *Quantities and units — Part 0: General principles* **A1**

Annex ZA (normative)**Normative references to international publications with their relevant European publications**

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

Publication	Year	Title	EN	Year
ISO 140-3	1995	Acoustics — Measurements of sound insulation in buildings and of building elements — Part 3: Laboratory measurements of airborne sound insulation of building elements	EN ISO 140-3	1995
ISO 140-9	1985	Acoustics — Measurements of sound insulation in buildings and of building elements — Part 9: Laboratory measurements of room-to-room airborne sound insulation of a suspended ceiling with a plenum above it	EN 20140-9	1993
ISO 140-10	1991	Acoustics — Measurements of sound insulation in buildings and of building elements — Part 10: Laboratory measurements of airborne sound insulation of small building elements	EN 20140-10	1992

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001. Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager. Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553. Email: copyright@bsi-global.com.