


ACCEPTABLE PIPE GRADES: SDR35 GASKET JOINT ONLY.

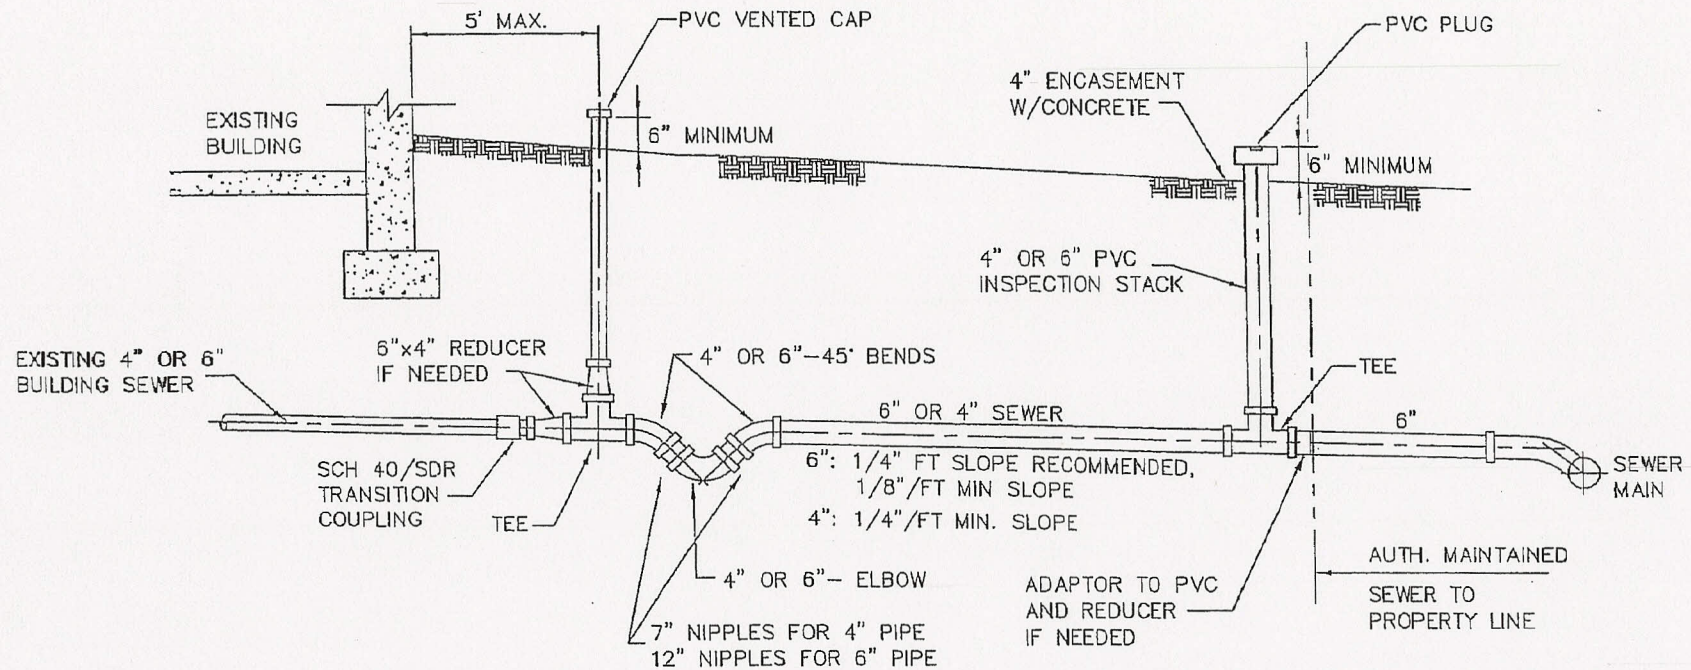

**NOTES:**

1. PLEASE CALL (724) 834-0911 FOR SERVICE SEWER INSPECTION BY AUTHORITY PRIOR TO BACKFILLING. A 24 HOUR NOTICE IS REQUIRED.
2. ALL PIPE IS TO BE BEDDED AND SURROUNDED BY 4" OF FIRMLY PACKED #2 CRUSHED STONE.
3. ANY 90° BENDS WILL REQUIRE TWO 45° BENDS WITH A MINIMUM OF 12" SEPERATION.
4. FOR LONG LATERALS, A CLEAN OUT MUST BE INSTALLED EVERY 100 FT. CLEAN OUT MUST BE A WYE AND 45°. (SEE DETAIL)
5. 4" OR 6" SERVICE SEWER ONLY PERMITTED FOR SINGLE FAMILY RESIDENTIAL CONNECTIONS.
6. ALL COMMERCIAL MUST BE 6".
7. INSPECTION STACKS MAY BE AT GROUND SURFACE IF AN APPROVED METAL CAP IS PROVIDED WITH CONCRETE PAD.
8. CLEANOUT/INSPECTION TEE PERFORATED CAPS NOT PERMITTED.

LATERAL SEWER DETAIL

THE HEMPFIELD TOWNSHIP MUNICIPAL AUTHORITY  
WESTMORELAND COUNTY, PENNSYLVANIA  
SEPTEMBER 2009

