



Certificate # 3512.05

**Construction Materials Testing Laboratory**  
**Jubail Branch**

P.O. Box 2165 - Tel.: (013) 341 2700  
Damman 31451 - Fax.: (013) 341 2701  
Saudi Arabia - E-mail.: [fslijubail@fugro-suhaimi.com](mailto:fslijubail@fugro-suhaimi.com)



السحيمي - فيفرو

**SUMMARY OF TEST REPORT**


<b>Client</b>	A.H. Al Marhoon & Bros. Co.	<b>Job No.</b>	SA08-3012
<b>Project</b>	Concrete Batch Plant, Rahima	<b>Lab No.</b>	11366
<b>Material</b>	3/4" (20 mm) Coarse Aggregate	<b>Date Sampled</b>	02 Sept. 2015
<b>Source</b>	Al Osais, Abuhadriya (Sampled by FSL)	<b>Date Reported</b>	13 Sept. 2015

**Properties:**

Properties Tested	Test Method	Results	SCECO Specs.
Sieve analysis	ASTM C-136	See Attached	--
Material finer than No. 200 sieve %	ASTM C-117	0.68	5.0 Max.
Clay lumps & friable particles %	ASTM C-142	0.46	1.0 Max.
Los Angeles Abrasion	ASTM C-131		
Loss at 100 revolutions %		8.1	--
Loss at 500 revolutions %		31.9	35 Max.
Ratio 100/500 rev.		0.25	0.25 max
Magnesium sulfate soundness loss (5 cycles) %	ASTM C-88	9.7	18 Max.
Specific gravity and absorption	ASTM C-127		
Apparent		2.629	--
SSD basis		2.573	--
Dry basis		2.560	--
Absorption		0.99	2.5 max
Acid soluble chloride, (Cl), %	ASTM C 114		
(NaCl), %		0.012	0.03 max
Acid soluble sulphate (SO <sub>3</sub> ), %	BS-812 Part 118		
(SO <sub>4</sub> ), %		0.014	
Flakiness index	BS-812	7.2	30 Max.
Elongation index	BS-812	9.5	45 Max.
Coal & lignite	ASTM C-123	NIL	0.5 Max.

**Remarks:**

**Tested By:** CBB **Reviewed By:** Imran Ahmed  
CTTA # : 0428 CTTA # : 0556

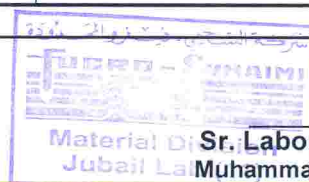

**Sr. Laboratory Supervisor**  
**Muhammad Nawaz CTTA # 0037**

The copyright of this document is owned by Fugro-Suhaimi Ltd. It may not be reproduced except with prior written approval from the company.



Certificate # 3512.05


Construction Materials Testing Laboratory  
Jubail Branch

P.O. Box 2165 - Tel.: (013) 341 2700  
Dammam 31451 - Fax.: (013) 341 2701  
Saudi Arabia - E-mail.: [fsliubail@fugro-suhaimi.com](mailto:fsliubail@fugro-suhaimi.com)



**PARTICLE SIZE ANALYSIS TEST REPORT**

Client	A.H. Al Marhoon & Bros. Co.	Job No.	SA08-3012
Project	Concrete Batch Plant, Rahima	Lab No.	11366
Material	3/4" (20 mm) Coarse Aggregate	Date Sampled	02 Sept. 2015
Source	Al Osais, Abuhadriya (Sampled by FSL)	Date Tested	03 Sept. 2015
Method	ASTM C-136/117	Date Reported	13 Sept. 2015

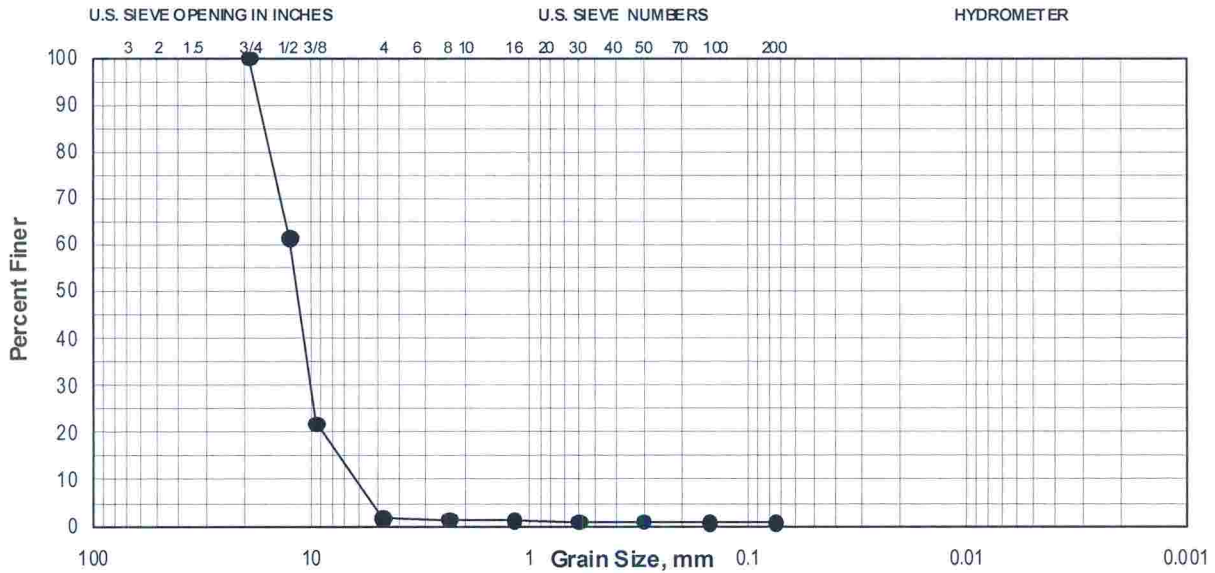

Gravel		Sand			Silt or Clay
Coarse	fine	Coarse	medium	fine	


Description of Sand / Gravel Particles:

Shape	Hardness	Specific Gravity

Sieve Size Inch(mm)	Passing g %	Specification	Properties Tested		
			Item	Description	Result
1 (25.0 mm)					
3/4 (19 mm)	100				
1/2 (12.5 mm)	61.5				
3/8 (9.5 mm)	22.0				
#4 (4.75 mm)	1.7				
#8 (2.36 mm)	1.52				
#16 (1.18 mm)	1.32				
#30 (0.600 mm)	1.00				
#50 (0.300 mm)	0.91				
#100 (0.150 mm)	0.75				
#200 (0.075 mm)	0.68				

Remarks	
---------	--

Tested By: CBB Reviewed By: Imran Ahmed  
CTTA #: 0428 PCTTA #: 0556

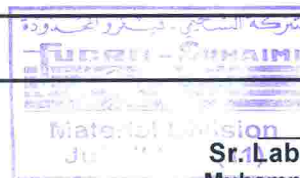

Sr. Laboratory Supervisor  
Muhammad Nawaz CTTA # 0037





Certificate # 3512.05

**Construction Materials Testing Laboratory  
Jubail Branch**

P.O. Box 2165 – Tel.: (013) 341 2700  
Dammam 31451 – Fax.: (013) 341 2701  
Saudi Arabia – E-mail.: [fsljubail@fugro-suhaimi.com](mailto:fsljubail@fugro-suhaimi.com)



**SUMMARY OF TEST REPORT**

<b>Client</b>	A.H. Al Marhoon & Bros. Co.	<b>Job No.</b>	SA08-3012
<b>Project</b>	Concrete Batch Plant, Rahima	<b>Lab No.</b>	11367
<b>Material</b>	3/8" (10- mm) Coarse Aggregate	<b>Date Sampled</b>	02 Sept. 2015
<b>Source</b>	Al Osais, Abuhadriya (Sampled by FSL)	<b>Date Reported</b>	13 Sept. 2015


**Properties:**

Properties Tested	Test Method	Results	SCECO Specs.
Sieve analysis	ASTM C-136	See Attached	--
Material finer than No. 200 sieve %	ASTM C-117	1.4	5.0 Max.
Clay lumps & friable particles %	ASTM C-142	0.47	1.0 Max.
Los Angeles Abrasion	ASTM C-131		
Loss at 100 revolutions %		8.2	--
Loss at 500 revolutions %		33.7	35 Max.
Ratio 100/500 rev.		0.24	0.25 max
Magnesium sulfate soundness loss (5 cycles) %	ASTM C-88	14.9	18 Max.
Specific gravity and absorption	ASTM C-127		
Apparent		2.637	--
SSD basis		2.575	--
Dry basis		2.537	--
Absorption		1.5	2.5 max
Acid soluble chloride, (Cl), %	ASTM C 114		
(NaCl), %		0.016	0.03 max
Acid soluble sulphate (SO <sub>3</sub> ), %	BS-812 Part 118		
(SO <sub>4</sub> ), %		0.192	
Flakiness index	BS-812	7.8	30 Max.
Elongation index	BS-812	10.2	45 Max.
Coal & lignite	ASTM C-123	NIL	0.5 Max.

**Remarks:**

Tested By: CBB  
CTTA # : 0428

Reviewed By: Imran Ahmed  
CTTA # : 0556

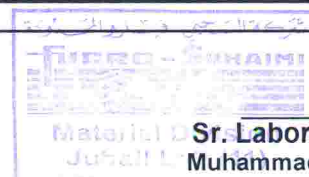

**Sr. Laboratory Supervisor**  
**Muhammad Nawaz CTTA # 0037**

The copyright of this document is owned by Fugro-Suhaimi Ltd. It may not be reproduced except with prior written approval from the company.

