


**TRENCH NOTES:**

- WHENEVER ROCK IS ENCOUNTERED IN TRENCH BOTTOM OVEREXCAVATION SHALL BE REQUIRED TO A MIN. OF 6" DEPTH BELOW O.D. OF PIPE AND REPLACED WITH 3/4" MINUS GRANULAR MATERIAL.
- MINIMUM COVER SHALL BE MEASURED FROM THE EXISTING OR PROPOSED GRADE OF PAVEMENT, OR FROM NATURAL GROUND, WHICHEVER IS DEEPER.
- CONTRACTOR SHALL CONFORM TO ALL OSHA STANDARDS AND REGULATIONS FOR TRENCH EXCAVATION AND PIPELINE INSTALLATION.
- PIPE BEDDING MATERIAL SHALL BE SELECT NATIVE MATERIAL MEETING 2" MINUS GRADATION.

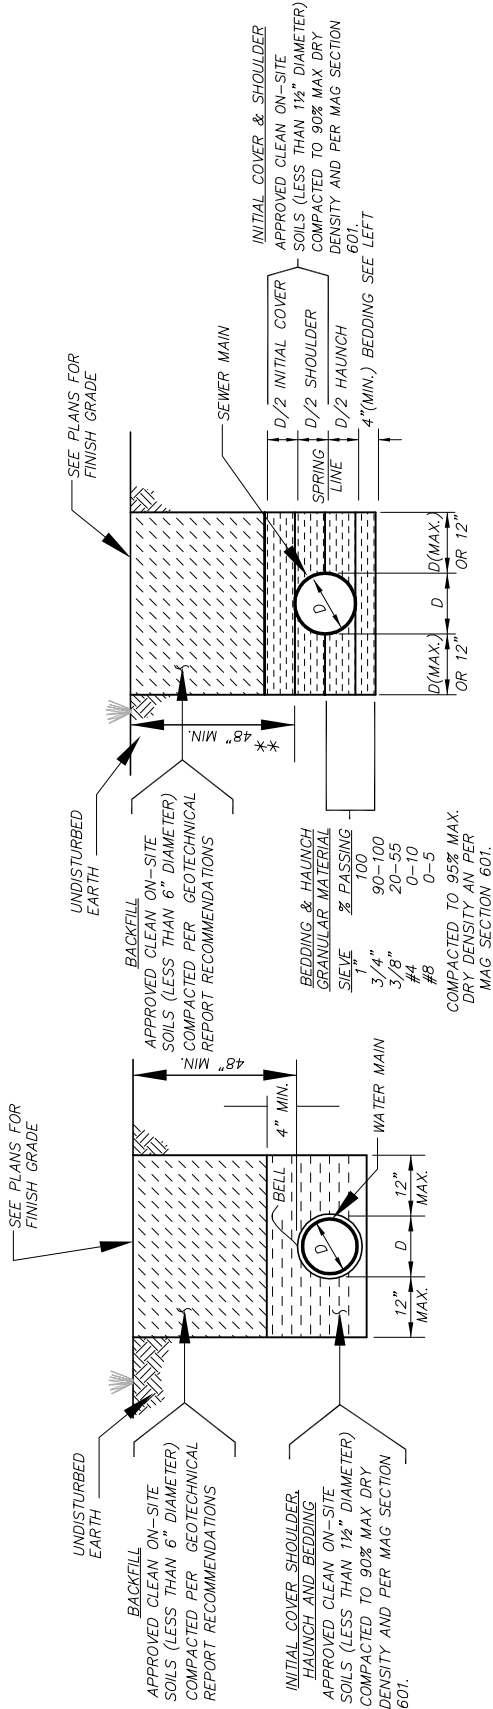

TRENCH CONDITION  
 (\*\* ( 8"-10" PIPE 48" COVER  
 12" AND LARGER 60" COVER  
 OR AS SHOWN ON THE PLANS)

TRENCH CONDITION  
 ( 6" AND SMALLER PIPE  
 OR AS SHOWN ON PLANS)

**SEWER PIPE TRENCH DETAIL**  
 (OR APPROVED EQUAL)  
 N.I.S.