


NOTE:

1. CLASS "C" CONCRETE AS PER SECTION 725
2. SEWER PIPE WILL BE PVC LINED DUCTILE IRON PIPE W/RESTRAINT JOINTS.
3. WATER LINE SHALL BE DUCTILE IRON PIPE W/RESTRAINT JOINTS.

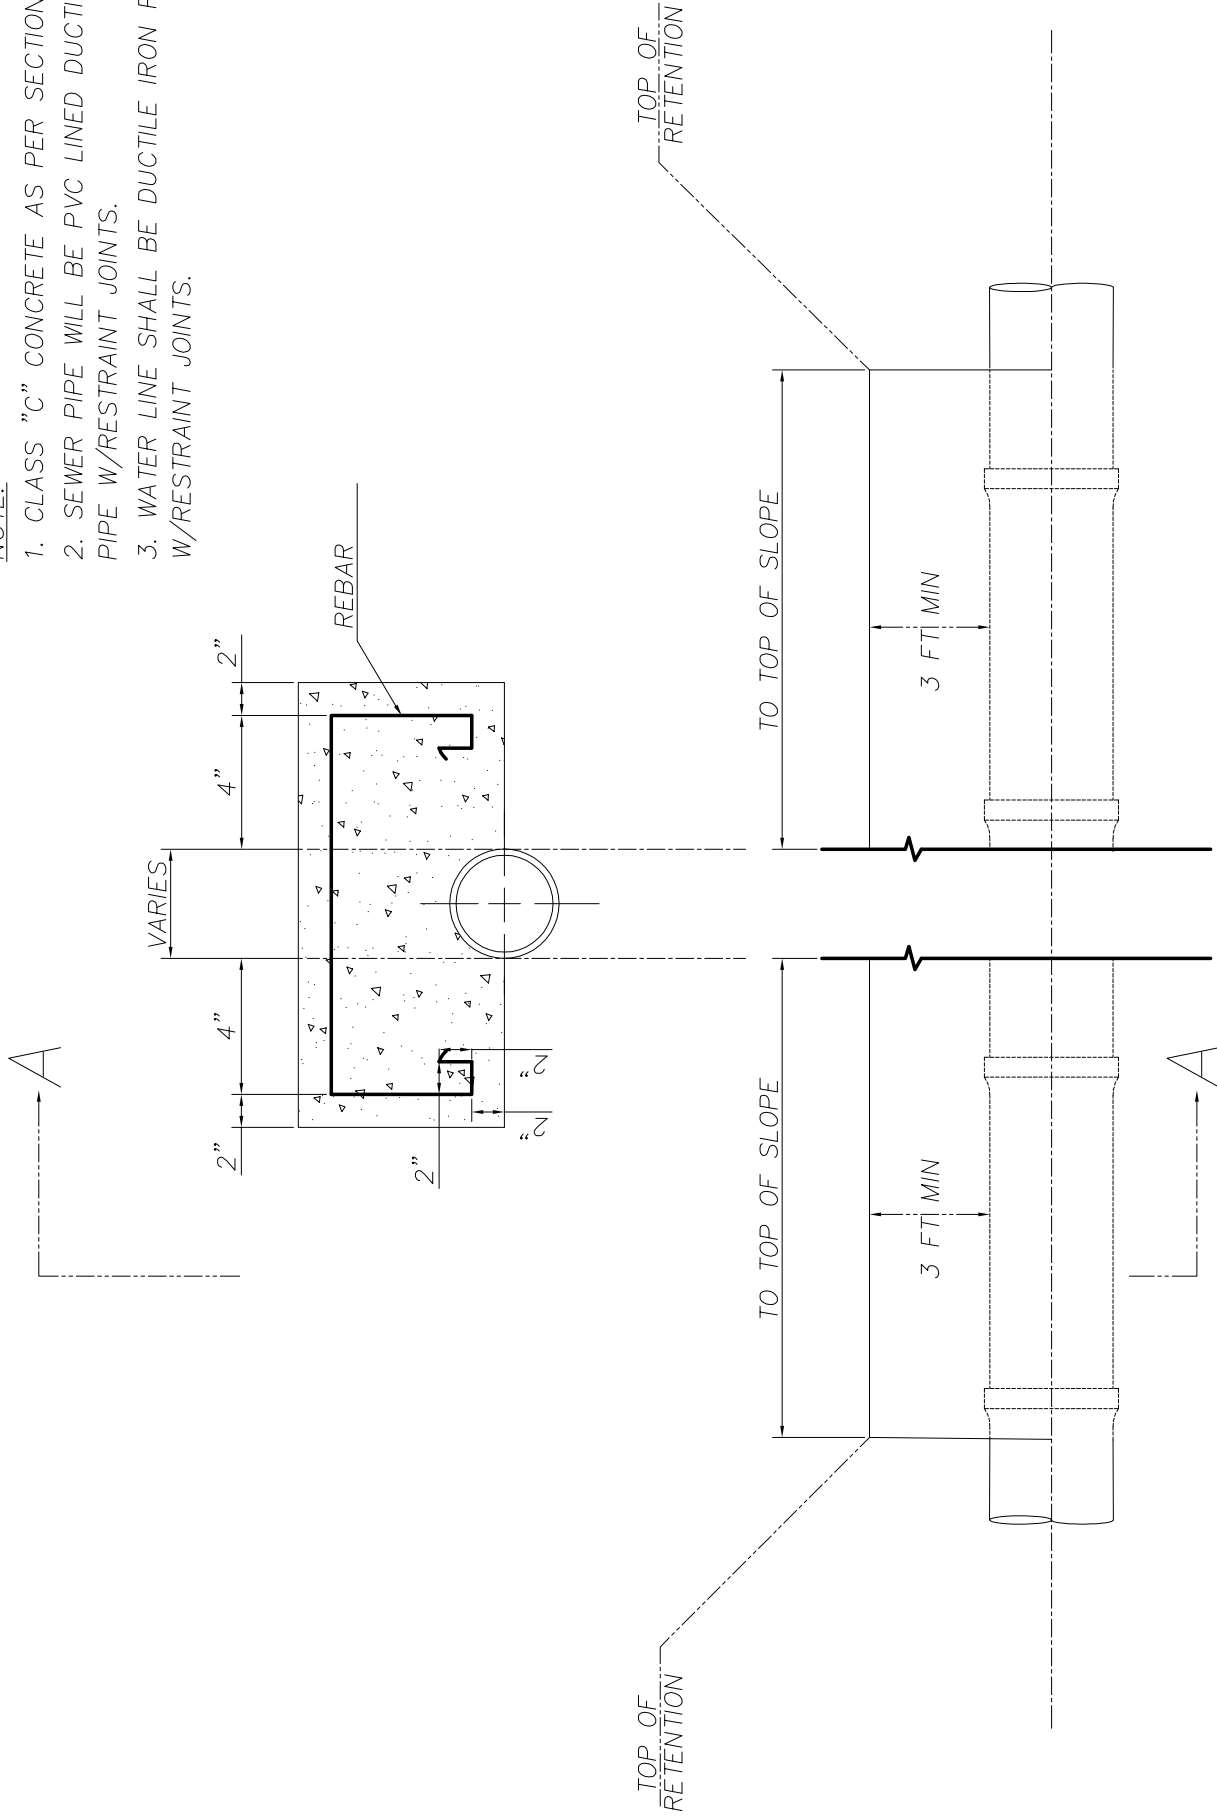

CONCRETE CAP FOR WATER OR SEWER PIPES CROSSING A RETENTION BASIN

JOHNSON UTILITIES, LLC
SCOTTSDALE, AZ

CONCRETE CAP

DETAIL NUMBER:
JU-4600