
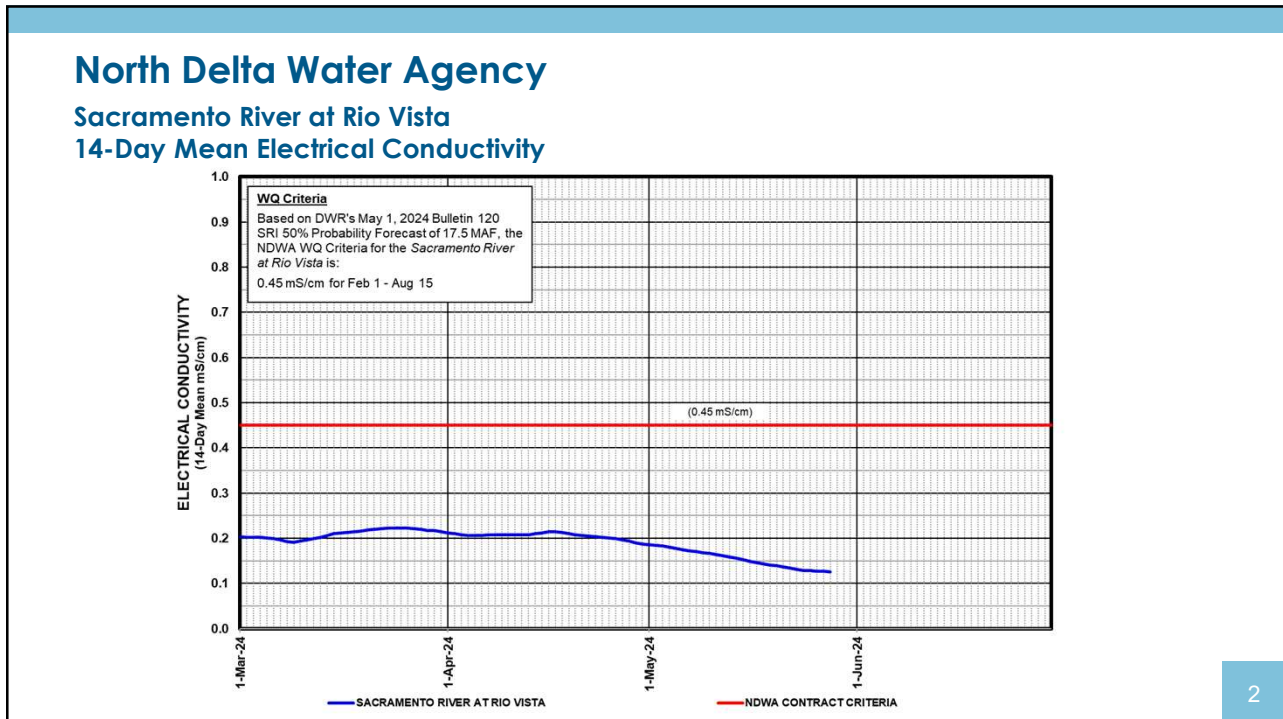


North Delta Water Agency
Board Meeting
June 5, 2024

Presented by:



1




2


North Delta Water Agency

Sacramento River at Three-Mile Slough

14-Day Mean Electrical Conductivity

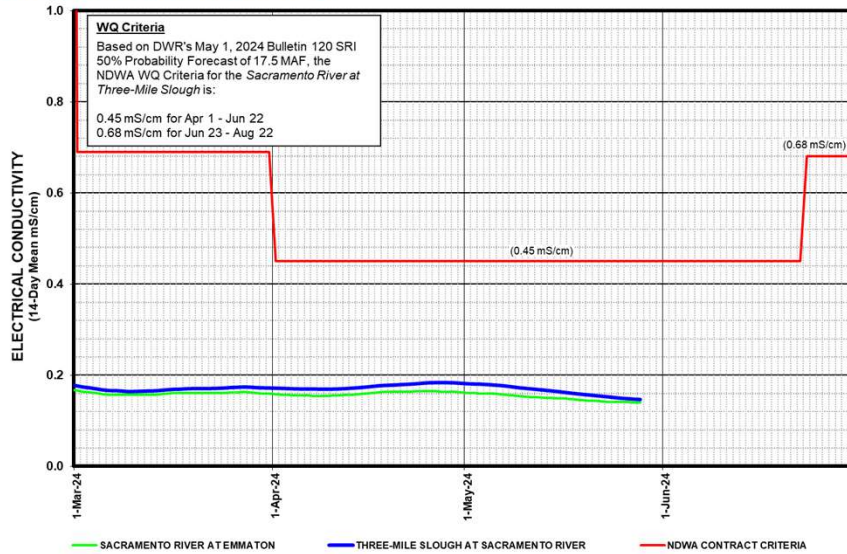


3

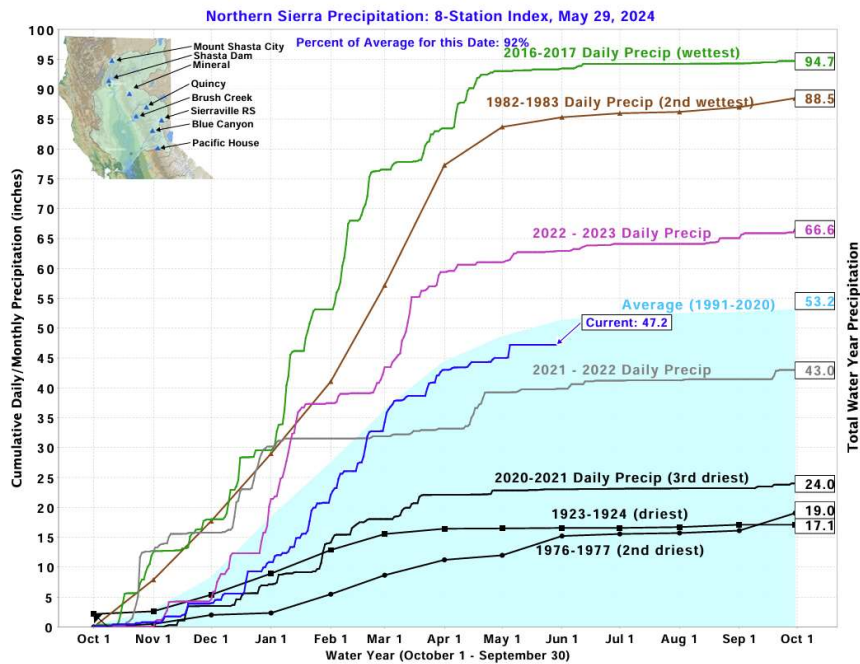


4

Snow Water Content

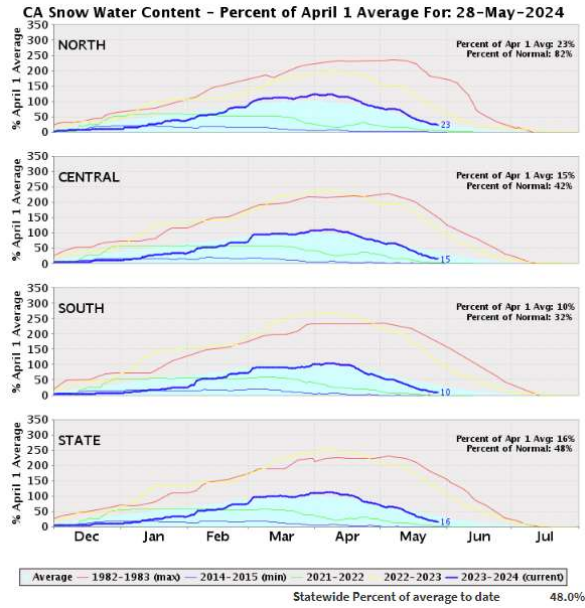



5

Current Reservoir Conditions

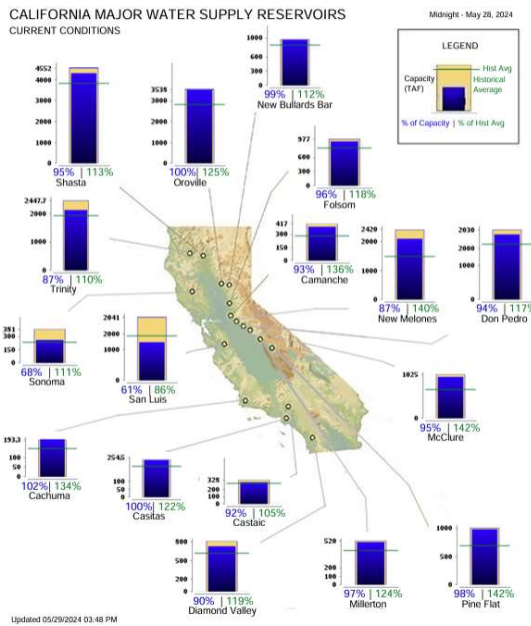

6

Lake Oroville Storage Levels

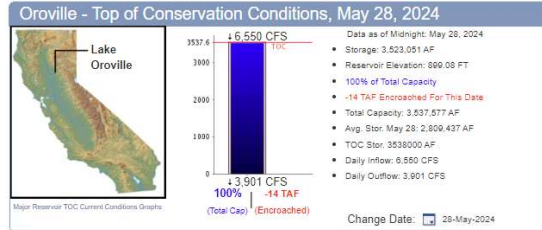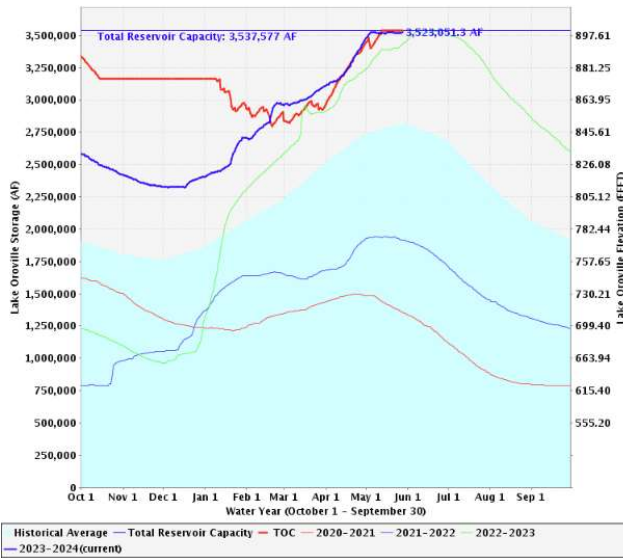

7

Hydrologic Conditions & Operations

- Total Delta Inflow ~25,300 cfs (5/29)
 - Sac River at Freeport = 18,300 cfs
- DCC Gates
 - Opening on weekends, closing on weekdays
- Delta Condition: Excess with Restrictions
- Water Supply Index May 1 Forecast Sac Valley Index
 - 8.44 MAF (50% Exceedance) – Above Normal

8



Questions & Discussion