

CAD#: I:\Baton Rouge\Amedisys Branch Offices\Amedisys Munster IN1 - New Location\01 FLOORPLAN\Amedisys_Munster IN_New Location_Floor Plan_003.dwg

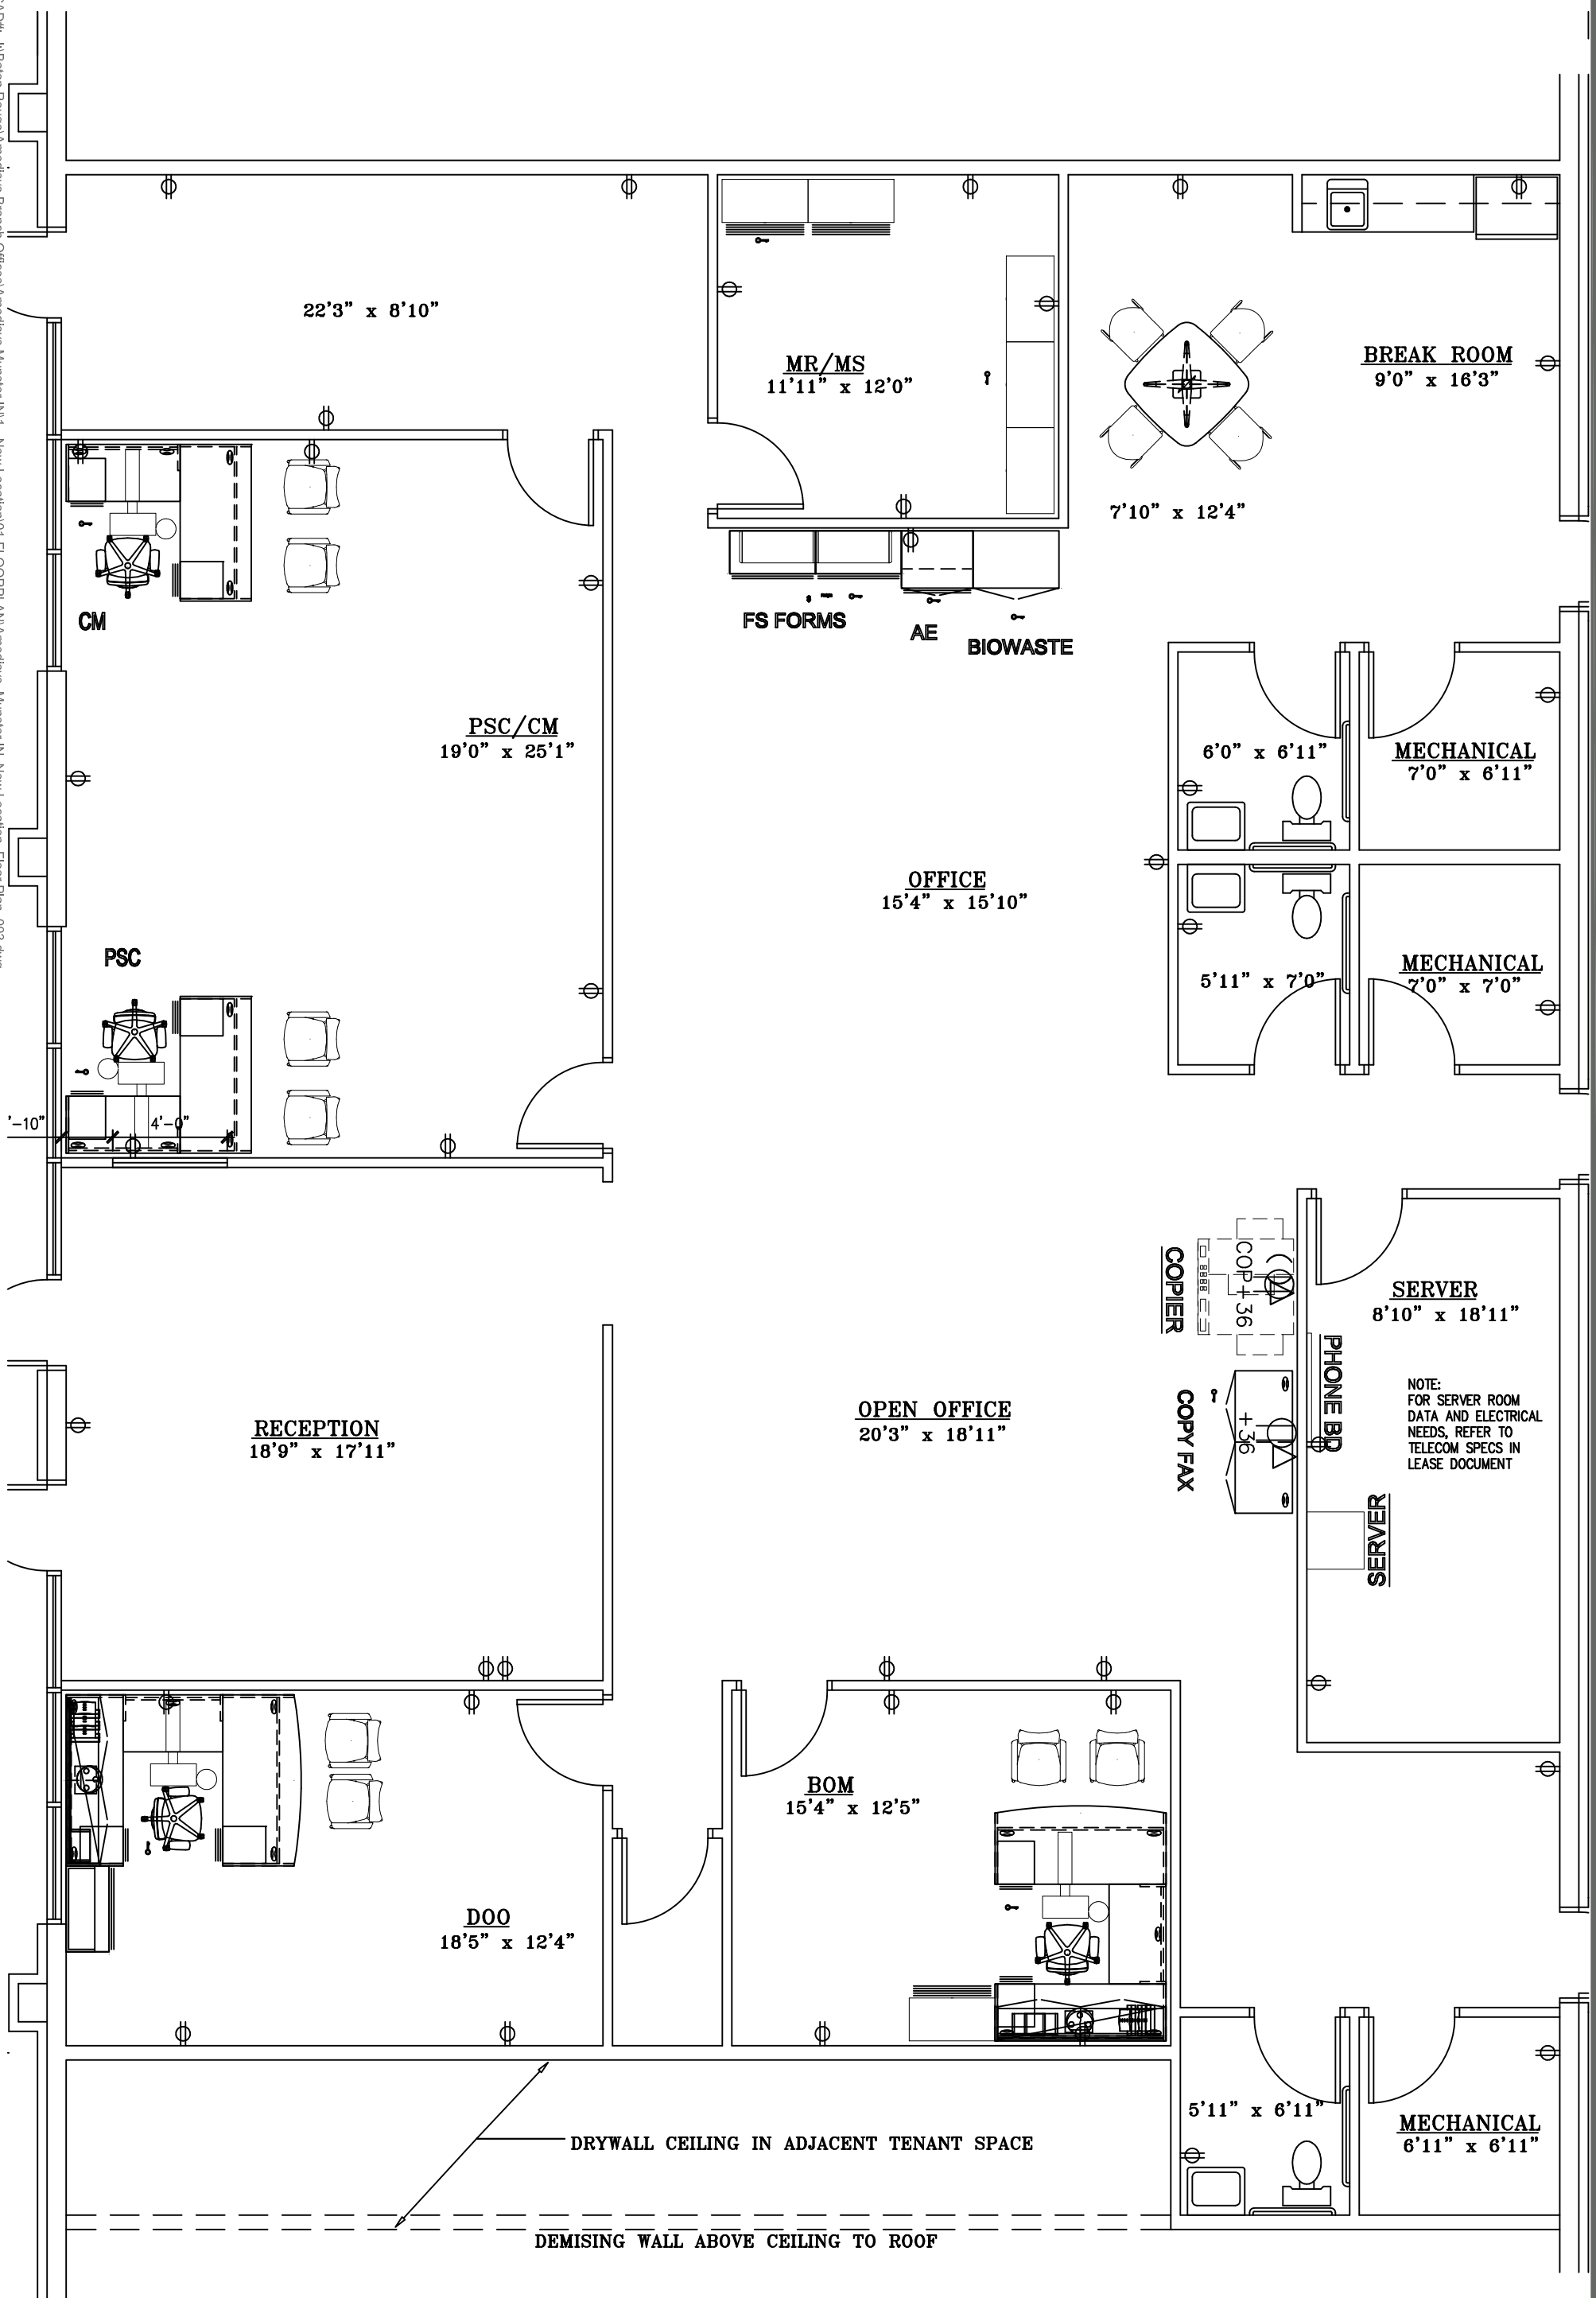


EXHIBIT "A-1"
ELECTRICAL PLAN

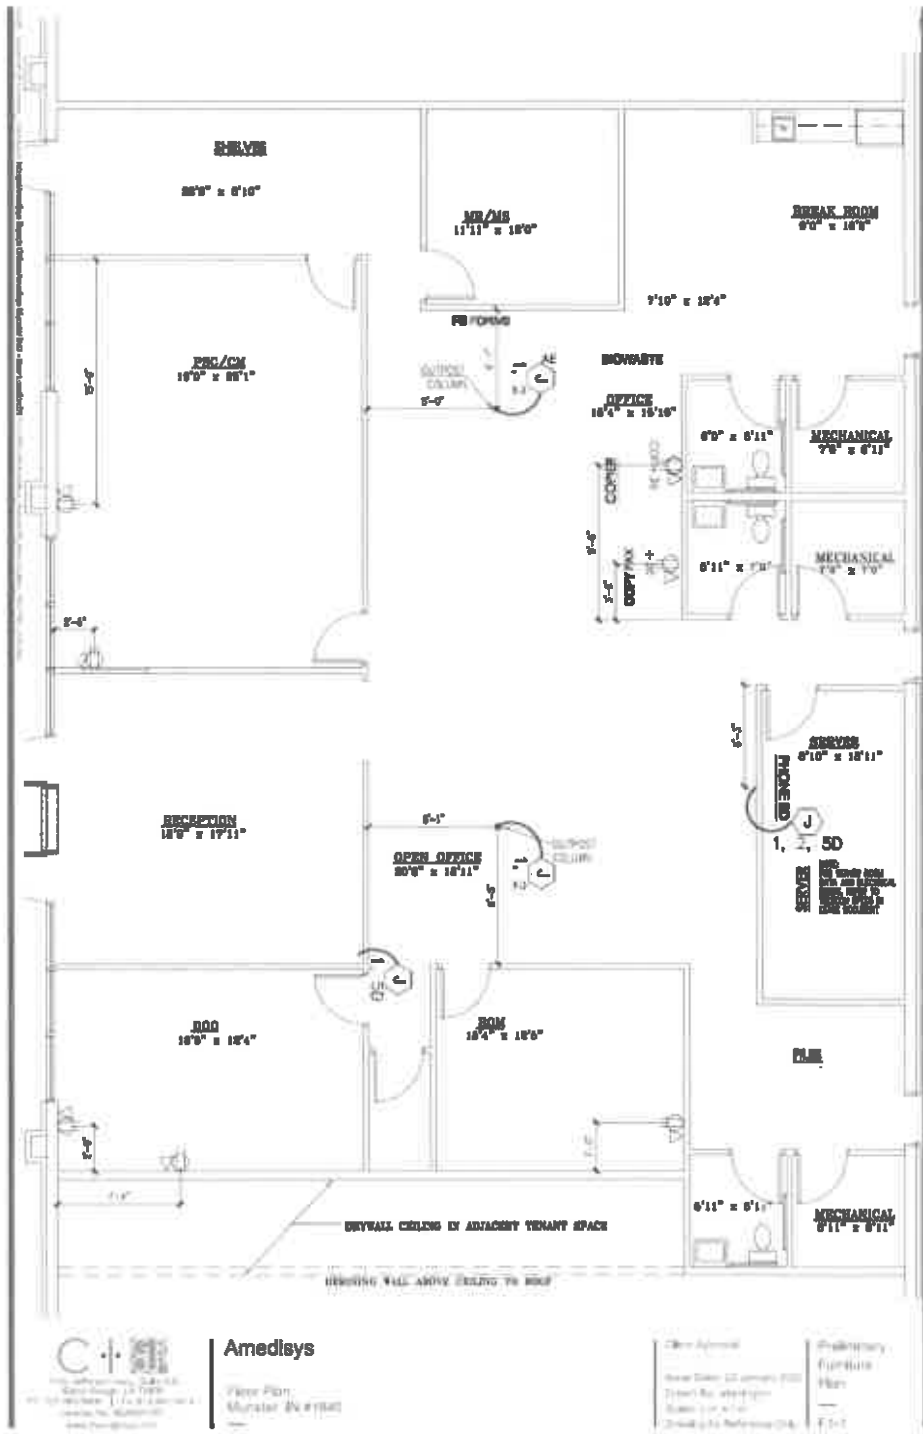











EXHIBIT "A-1"


ELECTRICAL PLAN

-  ↓-Box to be located above drop ceiling with Teklon 8T system circuit designation
-  →-Box to be located in dry wall for structure feed at 15' o.c. with Teklon 8T system circuit designation

Teklon 8T System Circuit Designations
 1 Teklon 8T system, 20 amp circuit 1, general purpose power, shared neutral and ground
 2 Teklon 8T system, 20 amp circuit 2, general purpose power, shared neutral and ground
 3 Teklon 8T system, 20 amp circuit 3, general purpose power, shared neutral and ground
 50 Teklon 8T system, 20 amp circuit 5, dedicated power, isolated neutral and ground

Please note: Teklon's national code 8T system is an 8 wire / 4 circuit system which provides circuit 1, circuit 2, and circuit 3 with a neutral and ground. Circuit 5 is provided with an isolated neutral and ground. The dedicated copier receptacle is to be a dedicated 120v 60 Hz 20 Amp Nema type 5-20R receptacle. See work letter specs for additional information.

-  Standard duplex receptacle
-  Standard duplex receptacle mounted 36" o.c.
-  2F dedicated duplex receptacle for dissector
-  2F dedicated duplex receptacle for multiplexer
-  Dedicated receptacle for copy machine mounted 36" o.c. (To be a dedicated 120v 60 Hz 20 Amp Nema type 5-20R)
-  2F dedicated duplex receptacle mounted 42" o.c.
-  NEW 120V, 20 AMP ISOLATED GROUND SEPARATE CIRCUIT DUPLEX OUTLET. SEE PART "LETTER 2000-05". (X IN OTHER ROOM)
-  NEW TELEPHONE/DATA LOCATION. TENANT USER TO PULL ALL FEEDS AND CABLES UP TO PROVIDE AND RUN AND STRING. VERIFY TYPE OF RECEPTACLE WITH TENANT.

 TEL/ DATA BACK BOARD LOCATION. INSTALL #6 BUILDING GROUND WITH BUS PANEL (SCHNEIDER ELECTRIC PART #PK707A) SCREWED TO PLYWOOD AT OUTLET HEIGHT TO ONE SIDE OF THE BOARD.

PROVIDE A 2" CONDUIT WITH FULL STRING FOR TELEPHONE SERVICE FROM THE BUILDING MPOE/ DEMARC TO TENANTS SERVER ROOM. CONDUIT TO BE STUBBED OUT DOWN THROUGH CEILING TILE ABOVE PLYWOOD BACKBOARD.

NOTE: I.T. CLOSET IS FOR TENANTS USE AND EQUIPMENT ONLY. O.C. IS TO CONFIRM WITH TENANT PRIOR TO INSTALLATION OF ANY SUPPLEMENTAL EQUIPMENT. SEE CEILING PLAN FOR MORE INFO.