


P:\86-0271\60103392 GEN DIST ENG SVCS\400 TECHNICAL\401 GENERAL DIST ENG SVCS\SUD PERMIT MANUAL\EXHIBITS\EXHIBIT VII.DWG

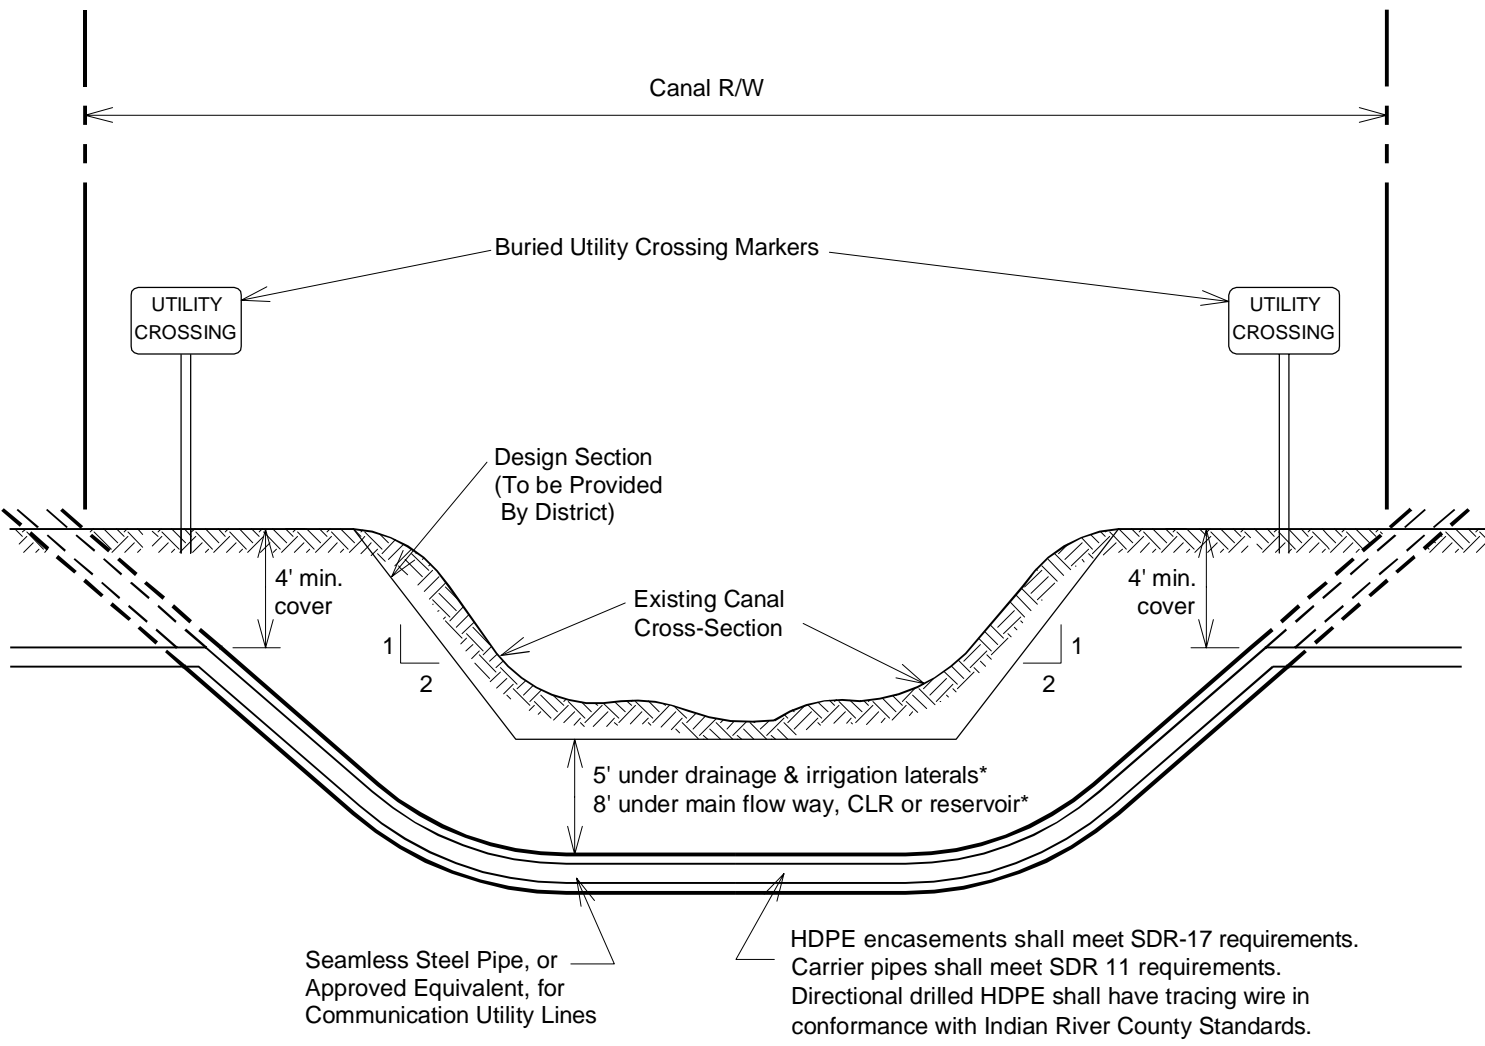

Seamless Steel Pipe, or Approved Equivalent, for Communication Utility Lines

HDPE encasements shall meet SDR-17 requirements. Carrier pipes shall meet SDR 11 requirements. Directional drilled HDPE shall have tracing wire in conformance with Indian River County Standards.

* As Measured to the Top of Pipe or Top of Encasement, Whichever is Higher.


NOTES:

- Open cut installations of under canal crossings are prohibited.
- Cover shall be measured from the top of the utility line's protective encasement to the existing canal bottom, original design section or, if known, ultimate section, whichever produces the lowest installation.

ELEVATION

Not to Scale

Indicate Location of Proposed Improvement Below:

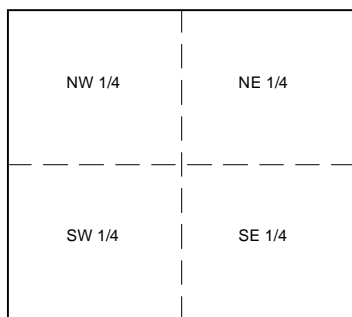

SEC. ____, TWP. ____, RGE. ____.

VICINITY PLAN

ST. JOHNS IMPROVEMENT DISTRICT	
SKETCH TO ACCOMPANY	
UNDER CANAL UTILITY CROSSING	
DATE:	APPLICATION NUMBER :
CANAL NO.:	APPLICANT: