

Nitrite Test Kit

1 drop = 40 ppm as NaNO_2 / 5 mL

TK3302-Z
green caps

KIT COMPONENTS:

ND2272-B Nitrite Titrant, 60 mL
FE3144-A Ferroin Indicator, 30 mL
VL-0525-V Vial, 5-25 mL

SAFETY TIPS:



Wear
Gloves



Use Eye
Protection



Read
SDS

TESTING TIPS:



Collect
Accurate
Sample



Hold
Bottles
Vertically




Ensure
Proper
Lighting

INTERFERENCES: This method is affected by any oxidizable substances in the sample such as Organic Matter, Sulfides, Hydrogen Sulfide, or any Mercaptans. If present, these substances can lead to positive interferences. Iron and Copper ions can lead to negative interferences. Lead and Iron ions can cause precipitation.

ATTENTION: As necessary, calibrate this kit against a known standard made with plant / make-up water. Be sure to collect a representative sample.

1 Rinse vial three times with sample to be tested. **Fill vial to 5 mL.**

Dilute to 10 mL with DI water if necessary.

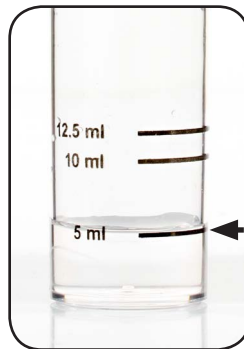


2 Add 8 drops of Ferroin Indicator (FE3144) and swirl to mix. The sample should turn orange.



3 Add Nitrite Titrant (ND2272) one drop at a time while swirling. Count the number of drops until the sample color changes from orange to blue.

drops x 40 = ppm as NaNO_2

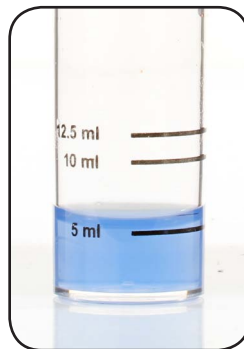

To convert Sodium Nitrite (NaNO_2) to Nitrite (NO_2):
Multiply results by 0.67.

To convert Nitrite (NO_2) to Sodium Nitrite (NaNO_2):
Multiply results by 1.5.



Video Procedure



TK3302-Z-PLUS REV 7/12