
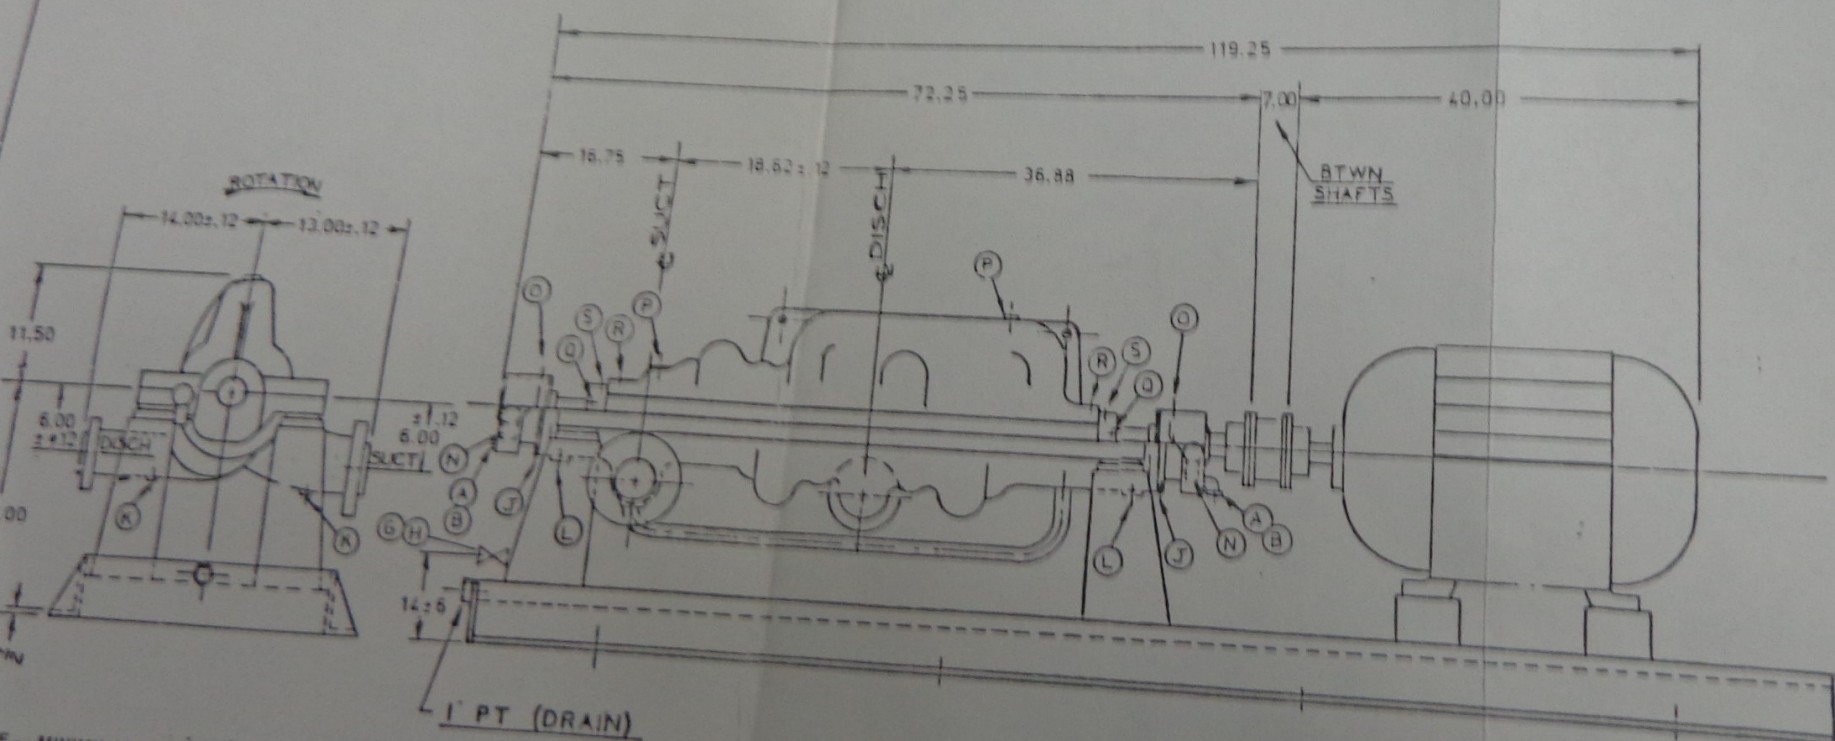


LEGEND		REF
1. RING FLANGE	2. PROTECTIVE CAP	3. TAP
4. BEARING HOLDING COOLING FLUID	5. BEARING HOLDING COOLING FLUID	6. BEARING HOLDING COOLING FLUID
7. BEARING HOLDING COOLING FLUID	8. BEARING HOLDING COOLING FLUID	9. BEARING HOLDING COOLING FLUID
10. BEARING HOLDING COOLING FLUID	11. BEARING HOLDING COOLING FLUID	12. BEARING HOLDING COOLING FLUID
13. BEARING HOLDING COOLING FLUID	14. BEARING HOLDING COOLING FLUID	15. BEARING HOLDING COOLING FLUID
16. BEARING HOLDING COOLING FLUID	17. BEARING HOLDING COOLING FLUID	18. BEARING HOLDING COOLING FLUID
19. BEARING HOLDING COOLING FLUID	20. BEARING HOLDING COOLING FLUID	21. BEARING HOLDING COOLING FLUID
22. BEARING HOLDING COOLING FLUID	23. BEARING HOLDING COOLING FLUID	24. BEARING HOLDING COOLING FLUID
25. BEARING HOLDING COOLING FLUID	26. BEARING HOLDING COOLING FLUID	27. BEARING HOLDING COOLING FLUID
28. BEARING HOLDING COOLING FLUID	29. BEARING HOLDING COOLING FLUID	30. BEARING HOLDING COOLING FLUID
31. BEARING HOLDING COOLING FLUID	32. BEARING HOLDING COOLING FLUID	33. BEARING HOLDING COOLING FLUID
34. BEARING HOLDING COOLING FLUID	35. BEARING HOLDING COOLING FLUID	36. BEARING HOLDING COOLING FLUID
37. BEARING HOLDING COOLING FLUID	38. BEARING HOLDING COOLING FLUID	39. BEARING HOLDING COOLING FLUID
40. BEARING HOLDING COOLING FLUID	41. BEARING HOLDING COOLING FLUID	42. BEARING HOLDING COOLING FLUID
43. BEARING HOLDING COOLING FLUID	44. BEARING HOLDING COOLING FLUID	45. BEARING HOLDING COOLING FLUID
46. BEARING HOLDING COOLING FLUID	47. BEARING HOLDING COOLING FLUID	48. BEARING HOLDING COOLING FLUID
49. BEARING HOLDING COOLING FLUID	50. BEARING HOLDING COOLING FLUID	51. BEARING HOLDING COOLING FLUID
52. BEARING HOLDING COOLING FLUID	53. BEARING HOLDING COOLING FLUID	54. BEARING HOLDING COOLING FLUID
55. BEARING HOLDING COOLING FLUID	56. BEARING HOLDING COOLING FLUID	57. BEARING HOLDING COOLING FLUID
58. BEARING HOLDING COOLING FLUID	59. BEARING HOLDING COOLING FLUID	60. BEARING HOLDING COOLING FLUID
61. BEARING HOLDING COOLING FLUID	62. BEARING HOLDING COOLING FLUID	63. BEARING HOLDING COOLING FLUID
64. BEARING HOLDING COOLING FLUID	65. BEARING HOLDING COOLING FLUID	66. BEARING HOLDING COOLING FLUID
67. BEARING HOLDING COOLING FLUID	68. BEARING HOLDING COOLING FLUID	69. BEARING HOLDING COOLING FLUID
70. BEARING HOLDING COOLING FLUID	71. BEARING HOLDING COOLING FLUID	72. BEARING HOLDING COOLING FLUID
73. BEARING HOLDING COOLING FLUID	74. BEARING HOLDING COOLING FLUID	75. BEARING HOLDING COOLING FLUID
76. BEARING HOLDING COOLING FLUID	77. BEARING HOLDING COOLING FLUID	78. BEARING HOLDING COOLING FLUID
79. BEARING HOLDING COOLING FLUID	80. BEARING HOLDING COOLING FLUID	81. BEARING HOLDING COOLING FLUID
82. BEARING HOLDING COOLING FLUID	83. BEARING HOLDING COOLING FLUID	84. BEARING HOLDING COOLING FLUID
85. BEARING HOLDING COOLING FLUID	86. BEARING HOLDING COOLING FLUID	87. BEARING HOLDING COOLING FLUID
88. BEARING HOLDING COOLING FLUID	89. BEARING HOLDING COOLING FLUID	90. BEARING HOLDING COOLING FLUID
91. BEARING HOLDING COOLING FLUID	92. BEARING HOLDING COOLING FLUID	93. BEARING HOLDING COOLING FLUID
94. BEARING HOLDING COOLING FLUID	95. BEARING HOLDING COOLING FLUID	96. BEARING HOLDING COOLING FLUID
97. BEARING HOLDING COOLING FLUID	98. BEARING HOLDING COOLING FLUID	99. BEARING HOLDING COOLING FLUID
100. BEARING HOLDING COOLING FLUID	101. BEARING HOLDING COOLING FLUID	102. BEARING HOLDING COOLING FLUID

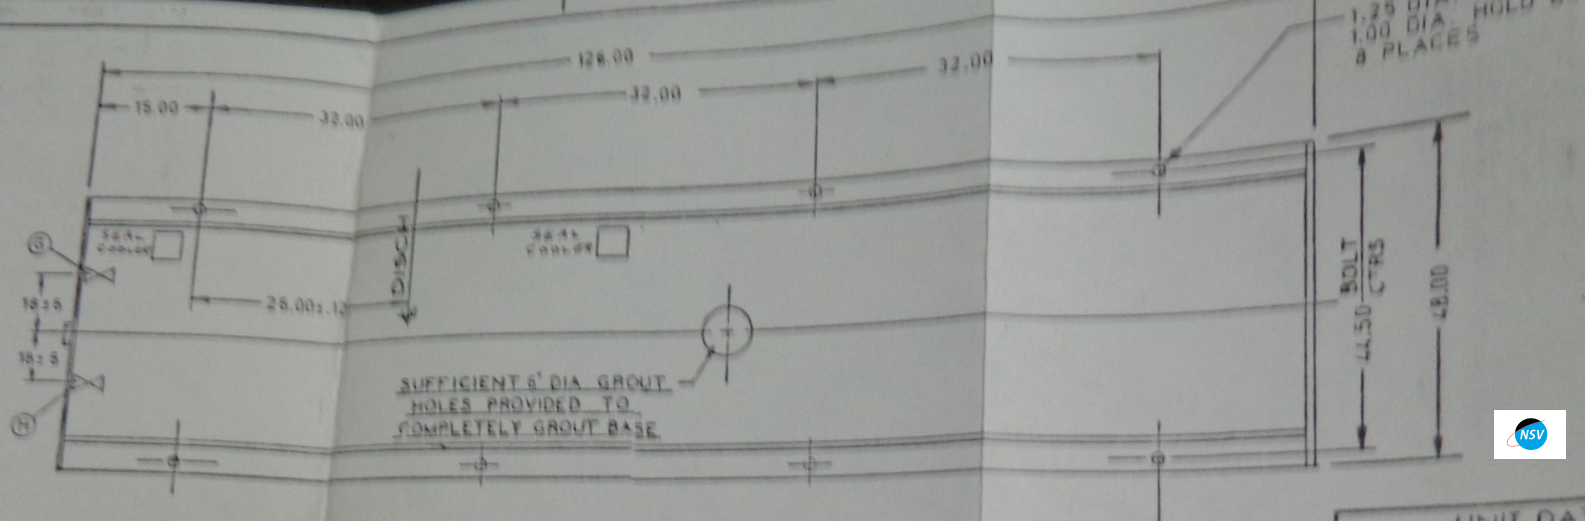

UNIT DATA	
PUMP SPECIFIC	
SIZE and TYPE, 3 X 4 X 8	NO STAGES, 8
ROTATION, CCW	DISCHARGE FLG 3", 60
SUCTION FLANGE, 4", 60	MECH SEAL, JOHN CR
TYPE, 881	CODE, X
PACKING, NO RINGS	SIZE, ASSEMBLY,
COUPLING	
TYPE, METASTRM TSA	
GUARD, ALUMINUM	

DRIVER SPECIFIC	
MOTOR, SIEMENS	
FURNISHED BY, BINGHA	
FRAME, 5050S	
HP, 250	SPEED, 4160 VOLT, 3 PHASE,
DIMEN PRINT, 53-811-	
GEAR, TYPE, FURNISHED BY,	
DIMEN PRINT,	

WEIGHTS	
PUMP, 1700	BASE, 2500
DRIVER, 2400	TOTAL, 6600 APPR

CUSTOMER	
USER, WRRR	
FOR INSTALLATION AT, WALLINGFORD, CT	
PURCHASER, FLUOR ENGINE	
PURCHASE ORDER NO., 620606-4-060	
ITEM NO., P-200A	
SERVICE, BOILER, 500	

— MINIMUM FLOW BY-PASS
 INSTRUCTED BY-PASS MUST BE PROVIDED FROM THIS DISCHARGE
 PRIMARY SUCTION SOURCE TO PERMIT A FLOW
 55 GPM MINIMUM CUSTOMER TO PROVIDE FLOW
 VALVE TO CLOSE BY-PASS LINE AT DESIGN CAPACITY

CAUTION! CAREFULLY CHECK ALIGNMENT BEFORE STARTING UNIT.

NO HOLES IN FLANGES STRADDLE CENTER LINES

UNIT SHOULD BE RECEIVED BY ENGINEERING STRAINS
 CERTIFIED FOR INSTALLATION

AVOID COOLING WATER CORROSION