

Sulfite Test Kit

1 drop = 2 or 10 ppm as Na_2SO_3 / 25 mL

TK3502-Z

orange caps


KIT COMPONENTS:

PI8056-B	Sulfite Titrant Low, 60 mL
PI8063-B	Sulfite Titrant High, 60 mL
PH1605-A	Phenolphthalein Indicator, 30 mL
ST5205-H	Starch Acid Powder, 10g
VL-1005-V	Vial, 10-50 mL


INTERFERENCES: All oxidizable substances such as Organic Matter, Sulfides and Nitrites, are positive interferences. Metals, namely copper, can stop or slow the chemical reaction. Adding one Sulfamic Acid powder pillow to the sample immediately following collection will minimize the interference. Sample should be covered and cooled to room temperature before testing. Exposure to air can be a negative interference.

- Cool the sample to room temperature
- Run test immediately after collecting and cooling the sample.

1 Rinse vial three times with sample to be tested. **Fill vial to 25 mL.**

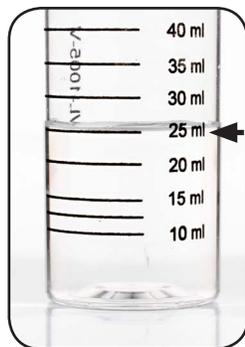

3 Add Starch Acid Powder (ST5205) one scoop at a time, swirling after each scoop, until the sample color changes from pink to colorless. Then, add two more scoops.

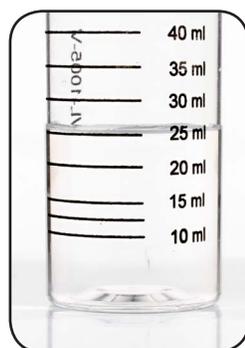

SAFETY TIPS:



Wear Gloves



Use Eye Protection



Read SDS

TESTING TIPS:



Collect Accurate Sample




Hold Bottles Vertically



Ensure Proper Lighting

ATTENTION: As necessary, calibrate this kit against a known standard made with plant / make-up water. Be sure to collect a representative sample.


2 Add 1 drop of Phenolphthalein Indicator (PH1605) and swirl to mix. The sample should turn pink.

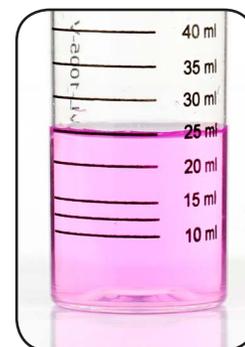

4 Add Sulfite Titrant one drop at a time while swirling. Count the number of drops until the sample color changes from colorless to blue.

Sulfite Titrant Low (PI8056)
drops x 2 = ppm as Na_2SO_3

Sulfite Titrant High (PI8063)
drops x 10 = ppm as Na_2SO_3

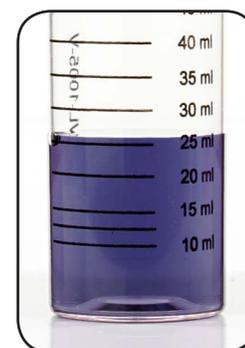

Video Procedure

