
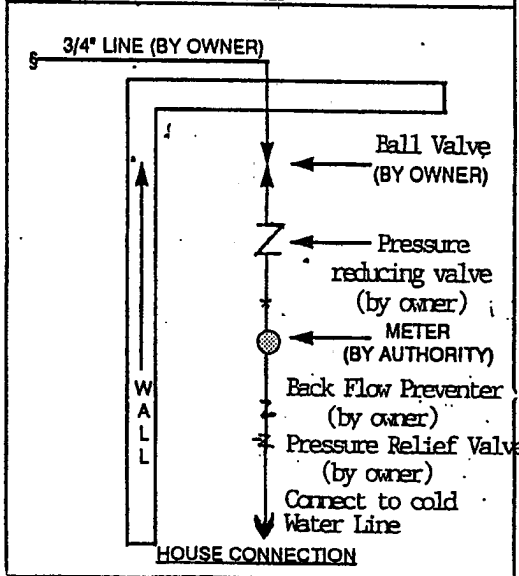


Water System Connection Information

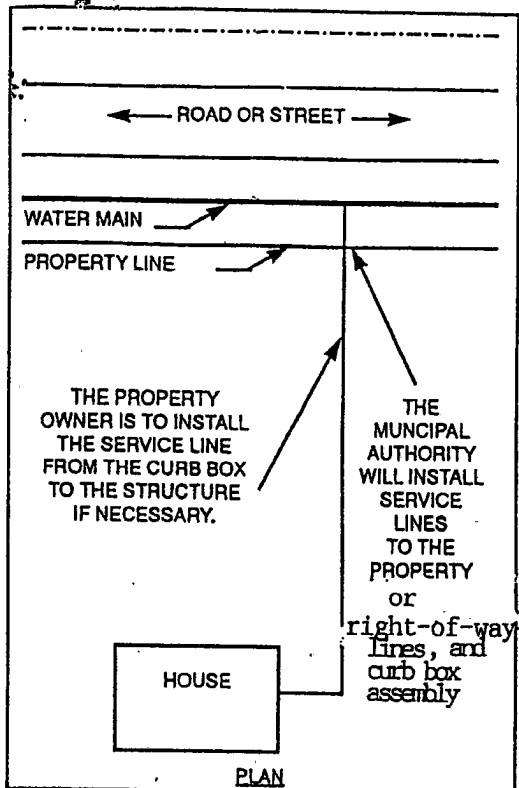

Specification of Materials:

SERVICE LINE FITTINGS-
Ford C- 44 –Griptite – Union.

SERVICE LINE – Type K Copper $\frac{3}{4}$ or larger $\frac{3}{4}$ inch or polyethylene Tubing (Copper Tubing sized).

BACKFLOW PREVENTER AND PRESSURE REDUCING VALVE –
Ball Valve – Ford B11-233
Backflow Preventer – Dual Cartridge Style Check.

The Spangler Municipal Authority recommends setting the pressure reducing valve between 50 – 80 lbs and the pressure relief valve at 75 lbs.

Back fill 6" on each side of service line to be sand or 2 RC stone.