


## ICRSD WWTP Capacity Analysis

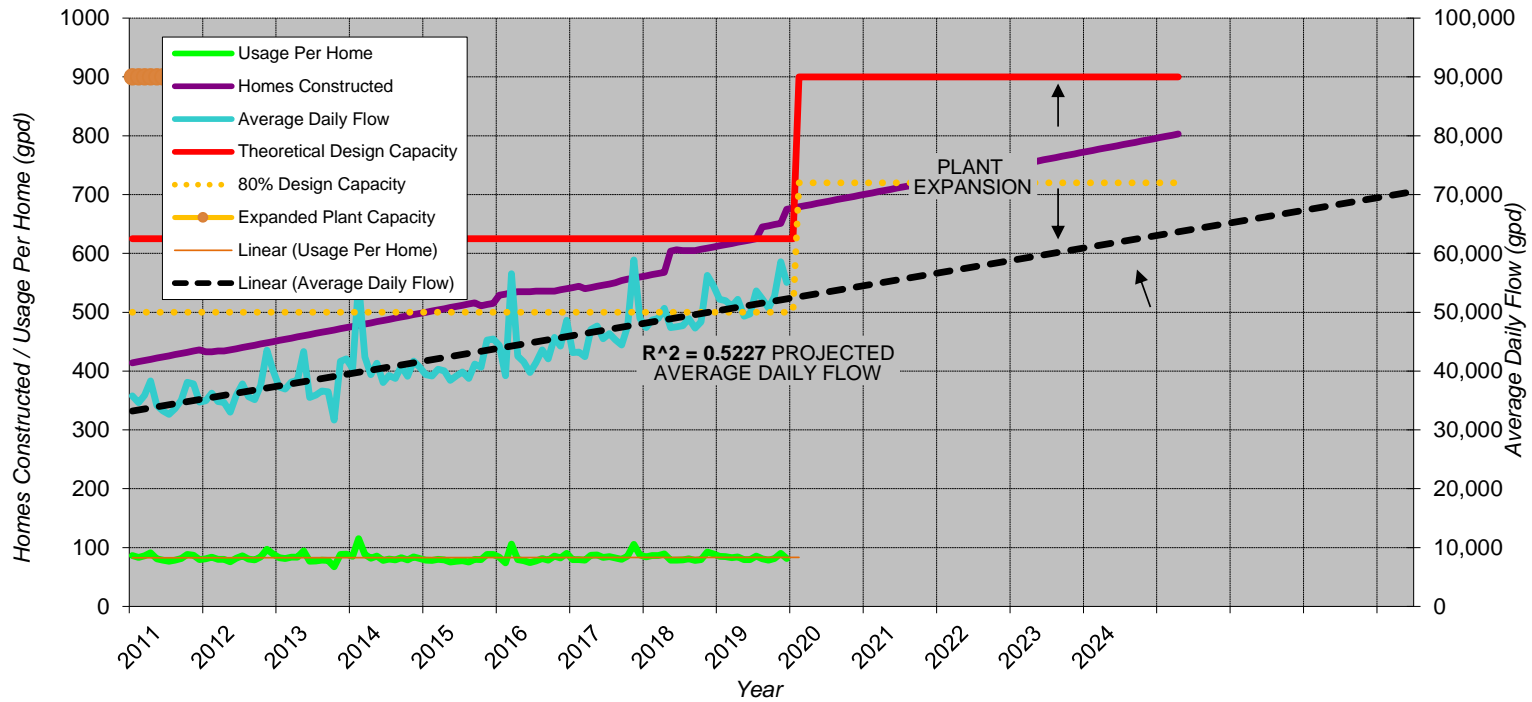

ICR Sanitary District Waste Water Treatment Plant Capacity Analysis Chart

Explanation of Terms:

Homes Constructed: Assumes a growth rate of 2 home per month or 24 homes per year added to the system (updated to Aug 2019)

Average Daily Flows: Total of the daily flows (as invoiced monthly to Talking Rock) by the days in the month.

Theoretical Design Capacity: Is not a fixed number. The assumed capacity of 62,500 gallons/day is achieved by operating the plant in the most conservative operational mode