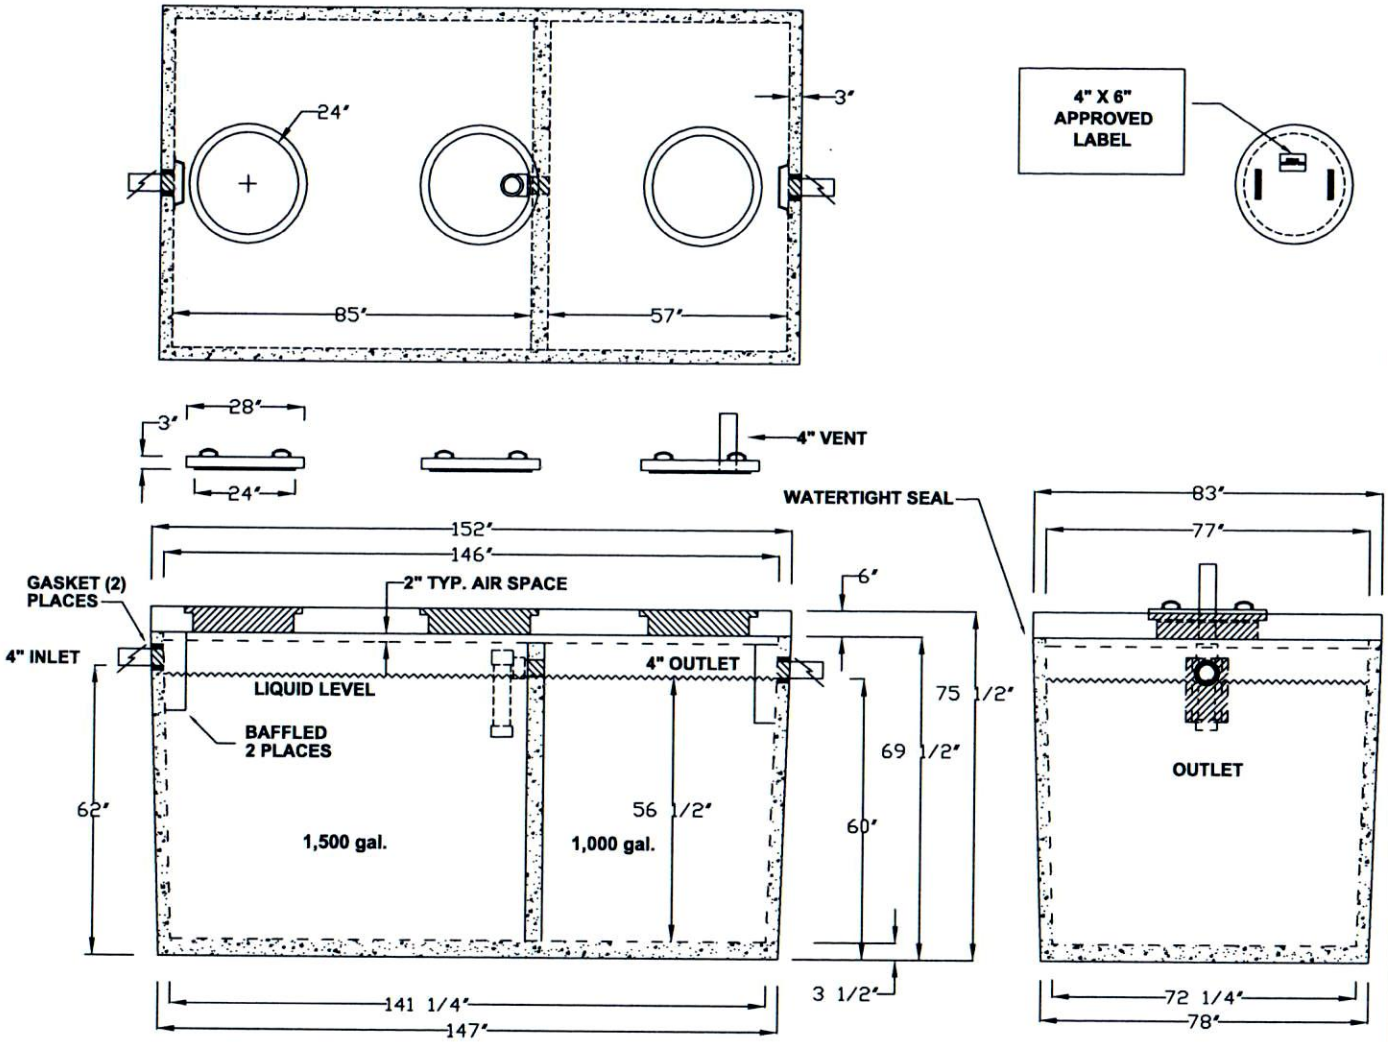

GROVE CONCRETE & SUPPLY, INC.
18426 DURAND AVENUE P.O. BOX 363
UNION GROVE, WISCONSIN 53182
(262) 878-2030 FAX (262) 878-4222
GroveConcrete.com

NOTES:

1. GALLONS PER INCH:
   1,000 COMPARTMENT - 17.74 gal/in
   1,500 COMPARTMENT - 26.61 gal/in
2. REINFORCED CONCRETE 4,000 PSI MIN.
3. (GASKETED 4" OR 6" OPENING) PRESS SEAL, TUFF TITE OR EQUAL.
4. (LABEL APPLIED TO COVER), WHEN USED AS A GREASE INTERCEPTOR.
5. 5' MAX DEPTH OF COVER, 8' BURIAL DEPTH WITH HEAVY DUTY COVER.
6. ALL BAFFLES & FILTERS TO BE INSTALLED TO MEET STATE & LOCAL CODES.
7. THIS TANK IS BUILT IN COMPLIANCE OF SECT. 905.40 IL. PRIVATE SEWAGE CODE.

(1,500 / 1,000) 2,500 2C GALLON PUMP, SEPTIC, HOLDING TANK, GREASE INTERCEPTOR

FOR ANY MODIFICATIONS CALL GROVE CONCRETE

APPROVED BY:		
DRAWN BY: RAY		DATE: 1/20/15
SCALE: NTS	EST. WIEGHT: 22,450 LBS.	VERSION: 00001
DWG. # TNK-2500-2C		ILL. APROVAL # 114

THIS DRAWING AND THE INFORMATION CONTAINED HEREON IS THE EXCLUSIVE PROPERTY OF GROVE CONCRETE & SUPPLY, INC., AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS EXCEPT AS AUTHORIZED THROUGH WRITTEN CONCENT FROM GROVE CONCRETE & SUPPLY, INC.