


## ICRSD WWTP Capacity Analysis

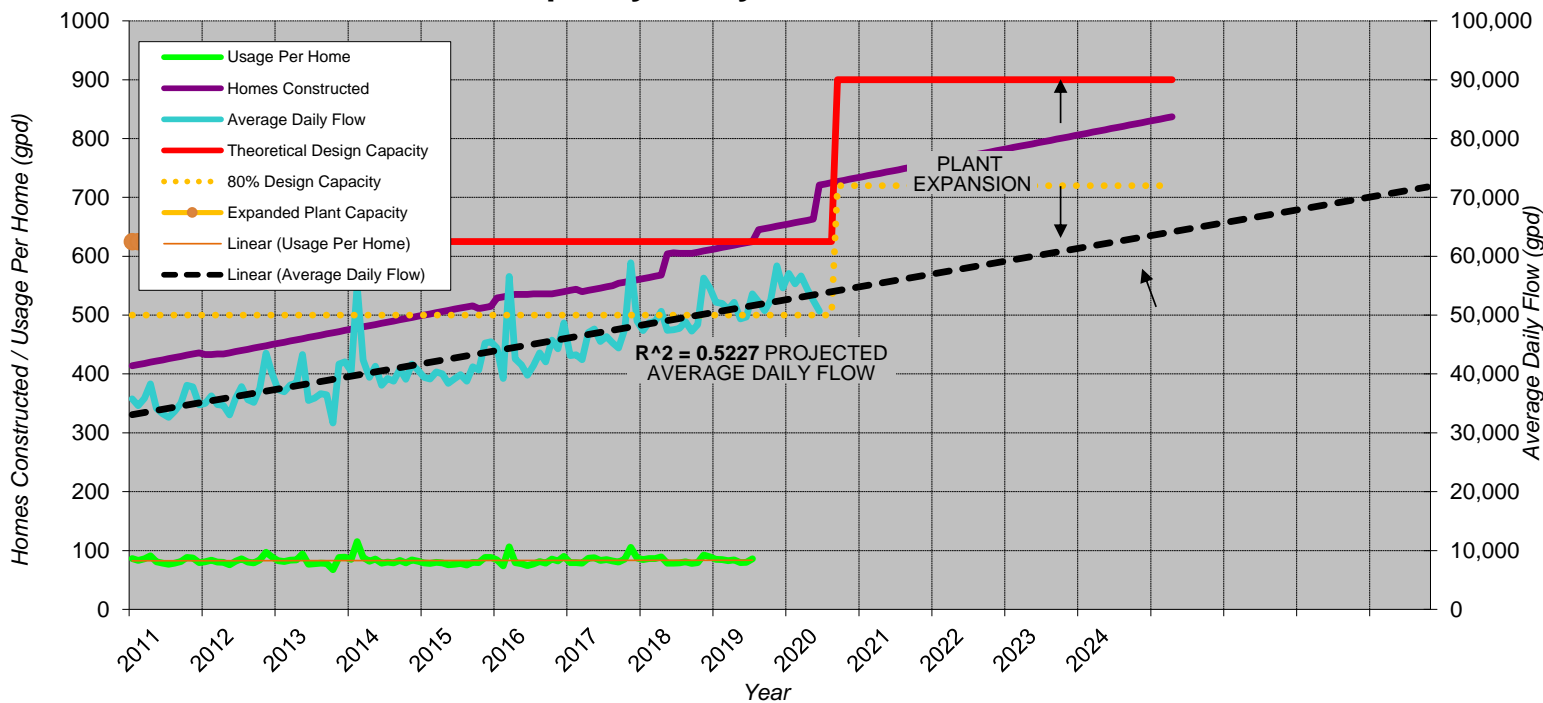

### ICR Sanitary District Waste Water Treatment Plant Capacity Analysis Chart

#### Explanation of Terms:

**Homes Constructed:** Assumes a growth rate of 2 home per month or 24 homes per year added to the system (updated to February 2020)

**Average Daily Flows:** Total of the daily flows (as invoiced monthly to Talking Rock) by the days in the month.

**Theoretical Design Capacity:** Is not a fixed number. The assumed capacity of 62,500 gallons/day is achieved by operating the plant in the most conservative operational mode