

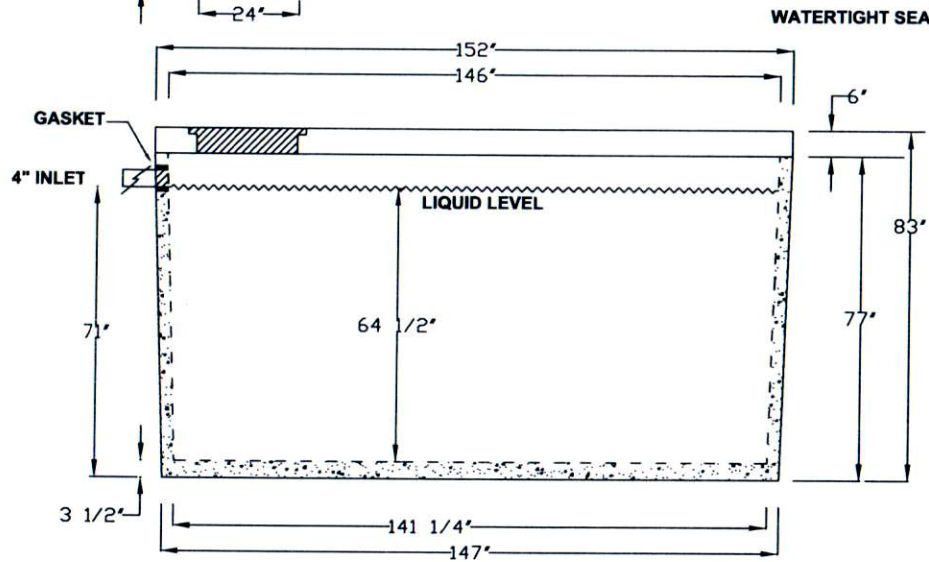


4" X 6"
APPROVED
LABEL



WATERTIGHT SEAL

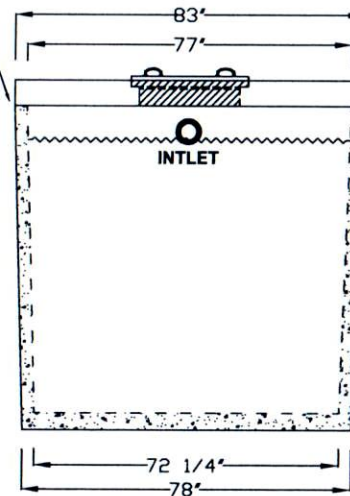

GROVE CONCRETE & SUPPLY, INC.
18426 DURAND AVENUE P.O. BOX 363
UNION GROVE, WISCONSIN 53182
(262) 878-2030 FAX (262) 878-4222
GroveConcrete.com

NOTES:

1. GALLONS PER INCH:
2,870 COMPARTMENT - 46.30 gal/in.
2. REINFORCED CONCRETE 4,000 PSI MIN.
3. (GASKETED 4" OR 6" OPENING)
PRESS SEAL, TUFF TITE OR EQUAL.
4. 5' MAX DEPTH OF COVER, 8' BURIAL
DEPTH WITH HEAVY DUTY COVER.
5. ALL BAFFLES & FILTERS TO BE
INSTALLED TO MEET STATE &
LOCAL CODES.
6. THIS TANK IS BUILT IN COMPLIANCE
OF SECT. 905.40 IL. PRIVATE SEWAGE
CODE.

3,100 GALLON, HOLDING TANK

FOR ANY MODIFICATIONS CALL
GROVE CONCRETE

APPROVED BY:

DRAWN BY:

RAY

DATE:

3/8/16

SCALE:
NTS

EST. WIEGHT:
21,700 LBS.

VERSION:
00004

DWG. #

TNK-3100-VER-4

ILL. APPROVAL # 114

THIS DRAWING AND THE INFORMATION CONTAINED
HEREON IS THE EXCLUSIVE PROPERTY OF GROVE
CONCRETE & SUPPLY, INC., AND SHALL NOT BE
REPRODUCED, USED, OR DISCLOSED TO OTHERS
EXCEPT AS AUTHORIZED THROUGH WRITTEN CONCENT
FROM GROVE CONCRETE & SUPPLY, INC.